


Board of Commissioners Water System Information Sheet																														
Commissioner		District 3 – Nicole Massiah																												
Report Date		June 2026																												
Distribution System Overview																														
District 3 contains more than 560 miles of small diameter (less than 16”) water mains and more than 36 miles of large diameter (greater than 16”) water mains. The system in District 3 contains more than 4,400 fire hydrants to support fire protection efforts. There are 7 water tanks in District 3, at Columbia Drive, Whites Mill Road, McAfee Road, and Wesley Chapel Road. The tanks help to manage water pressure during periods of peak demand. Break data covers the period from 2017 through June 2026.																														
Small Diameter System Details																														
<table><tr><th>Pipe Construction</th><th>Feet</th><th>Miles</th></tr><tr><td>Asbestos Cement</td><td>628,740</td><td>119.1</td></tr><tr><td>Cast Iron</td><td>976,699</td><td>185.0</td></tr><tr><td>Copper</td><td>173,044</td><td>32.8</td></tr><tr><td>Ductile Iron</td><td>1,014,563</td><td>192.2</td></tr><tr><td>Galvanized</td><td>97,360</td><td>18.4</td></tr><tr><td>PVC</td><td>90,809</td><td>17.2</td></tr><tr><td>Other / Unknown</td><td>15,911</td><td>3.0</td></tr><tr><td>Total Feet</td><td>2,981,216</td><td>564.6</td></tr></table>				Pipe Construction	Feet	Miles	Asbestos Cement	628,740	119.1	Cast Iron	976,699	185.0	Copper	173,044	32.8	Ductile Iron	1,014,563	192.2	Galvanized	97,360	18.4	PVC	90,809	17.2	Other / Unknown	15,911	3.0	Total Feet	2,981,216	564.6
Pipe Construction	Feet	Miles																												
Asbestos Cement	628,740	119.1																												
Cast Iron	976,699	185.0																												
Copper	173,044	32.8																												
Ductile Iron	1,014,563	192.2																												
Galvanized	97,360	18.4																												
PVC	90,809	17.2																												
Other / Unknown	15,911	3.0																												
Total Feet	2,981,216	564.6																												
Large Diameter System Details																														
<table><tr><th>Pipe Construction</th><th>Feet</th><th>Miles</th></tr><tr><td>Cast Iron</td><td>12,814</td><td>2.4</td></tr><tr><td>Carbon Steel</td><td>82,938</td><td>15.7</td></tr><tr><td>Ductile Iron</td><td>90,913</td><td>17.2</td></tr><tr><td>Prestressed Concrete Cylinder Pipe</td><td>5,976</td><td>1.1</td></tr><tr><td>Other / Unknown</td><td>6</td><td>0.0</td></tr><tr><td>Total Feet</td><td>192,641</td><td>36.5</td></tr></table>				Pipe Construction	Feet	Miles	Cast Iron	12,814	2.4	Carbon Steel	82,938	15.7	Ductile Iron	90,913	17.2	Prestressed Concrete Cylinder Pipe	5,976	1.1	Other / Unknown	6	0.0	Total Feet	192,641	36.5						
Pipe Construction	Feet	Miles																												
Cast Iron	12,814	2.4																												
Carbon Steel	82,938	15.7																												
Ductile Iron	90,913	17.2																												
Prestressed Concrete Cylinder Pipe	5,976	1.1																												
Other / Unknown	6	0.0																												
Total Feet	192,641	36.5																												
Water Main Breaks Since 2017																														
District 3 Breaks since 2017		District 3 Breaks since 2017																												
Large Diameter	21	Large Diameter	203																											
Small Diameter	2,085	Small Diameter	9,368																											

Water Main Breaks Since 2017

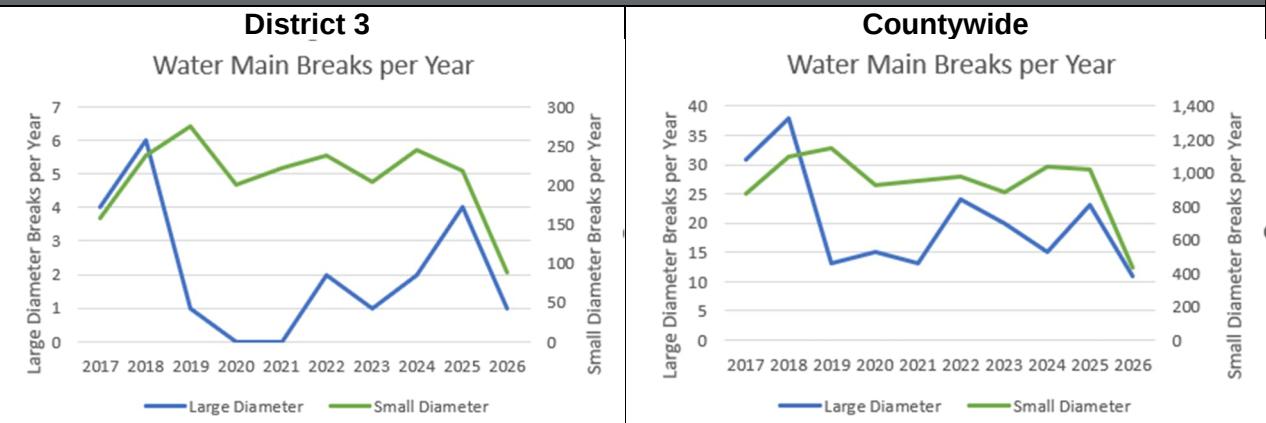

Key Upcoming / Ongoing Projects

Project Name	Benefit
PCCP Transmission Main Replacement Phase A (Glendale)	Replacement of deteriorated PCCP water transmission mains
Shoal Creek Trunk Sewer Section 1	Capacity related upsizing of sewer primarily in same trench or parallel to existing sewer
Columbia Water Tank Replacement (steel)	Replacement of existing storage tank & Pump Station