


Board of Commissioners Water System Information Sheet																														
Commissioner		Super District 7 – Dr. LaDena Bolton																												
Report Date		June 2026																												
Distribution System Overview																														
Super District 7 contains more than 1,600 miles of small diameter (less than 16”) water mains and 160 miles of large diameter (greater than 16”) water mains. The system in Super District 7 contains more than 13.900 fire hydrants to support fire protection efforts. There are 10 water tanks in Super District 7 – 2 in Tucker, 2 on Redan Road, 2 on Columbia Drive, 2 on Wesley Chapel Road, and one each on McAfee Road and Parkway Road. The tanks help to manage water pressure during periods of peak demand. Break data covers the period from 2017 through June 2026.																														
Small Diameter System Details																														
<table><tr><th>Pipe Construction</th><th>Feet</th><th>Miles</th></tr><tr><td>Asbestos Cement</td><td>1,636,126</td><td>309.9</td></tr><tr><td>Cast Iron</td><td>2,186,327</td><td>414.1</td></tr><tr><td>Copper</td><td>641,823</td><td>121.6</td></tr><tr><td>Ductile Iron</td><td>3,195,945</td><td>605.3</td></tr><tr><td>Galvanized</td><td>141,037</td><td>26.7</td></tr><tr><td>PVC</td><td>800,232</td><td>151.6</td></tr><tr><td>Other / Unknown</td><td>104,663</td><td>19.8</td></tr><tr><td>Total Feet</td><td>8,601,490</td><td>1,629.1</td></tr></table>				Pipe Construction	Feet	Miles	Asbestos Cement	1,636,126	309.9	Cast Iron	2,186,327	414.1	Copper	641,823	121.6	Ductile Iron	3,195,945	605.3	Galvanized	141,037	26.7	PVC	800,232	151.6	Other / Unknown	104,663	19.8	Total Feet	8,601,490	1,629.1
Pipe Construction	Feet	Miles																												
Asbestos Cement	1,636,126	309.9																												
Cast Iron	2,186,327	414.1																												
Copper	641,823	121.6																												
Ductile Iron	3,195,945	605.3																												
Galvanized	141,037	26.7																												
PVC	800,232	151.6																												
Other / Unknown	104,663	19.8																												
Total Feet	8,601,490	1,629.1																												
Large Diameter System Details																														
<table><tr><th>Pipe Construction</th><th>Feet</th><th>Miles</th></tr><tr><td>Cast Iron</td><td>78,340</td><td>14.8</td></tr><tr><td>Carbon Steel</td><td>249,048</td><td>47.2</td></tr><tr><td>Ductile Iron</td><td>497,213</td><td>94.2</td></tr><tr><td>Prestressed Concrete Cylinder Pipe</td><td>22,119</td><td>4.2</td></tr><tr><td>Other / Unknown</td><td>6</td><td>0.0</td></tr><tr><td>Total Feet</td><td>846,721</td><td>160.4</td></tr></table>				Pipe Construction	Feet	Miles	Cast Iron	78,340	14.8	Carbon Steel	249,048	47.2	Ductile Iron	497,213	94.2	Prestressed Concrete Cylinder Pipe	22,119	4.2	Other / Unknown	6	0.0	Total Feet	846,721	160.4						
Pipe Construction	Feet	Miles																												
Cast Iron	78,340	14.8																												
Carbon Steel	249,048	47.2																												
Ductile Iron	497,213	94.2																												
Prestressed Concrete Cylinder Pipe	22,119	4.2																												
Other / Unknown	6	0.0																												
Total Feet	846,721	160.4																												
Water Main Breaks Since 2017																														
Super District 7 Breaks since 2017		Countywide Breaks since 2017																												
Large Diameter	82	Large Diameter	203																											
Small Diameter	4,779	Small Diameter	9,368																											

Water Main Breaks Since 2017

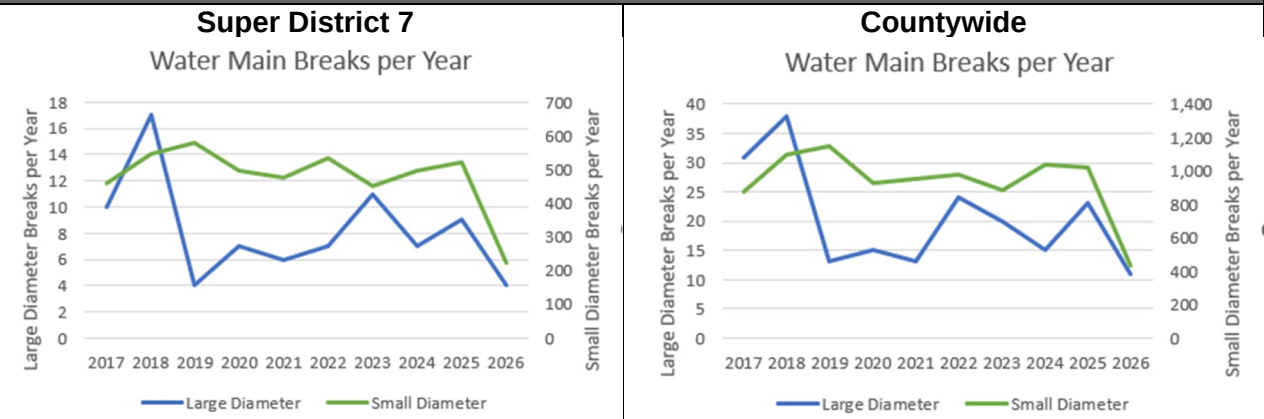

Key Upcoming Projects

Project Name	Benefit
60" Transmission Main Phase A	New 60" transmission main to help with current and future water demands throughout the County
PCCP Transmission Main Replacement Phase A (Glendale)	Replacement of deteriorated PCCP water transmission mains
Lavista Rd	Replacement of deteriorated cast iron water mains
Shoal Creek Trunk Sewer Section 1	Capacity related upsizing of key sewer trunk line