Office of the Chief Executive Officer
Zachary L. Williams
Executive Assistant, Chief Operating Officer

Chief Executive Offic
Lorraine Cochran-Johns

Board of Commissione
District
Robert Patri
District
Michelle Long Spea
District
Nicole Massi
District
Chakira Johns
District
Mereda D. Johns
District
Edward "Ted" Ter
District
LaDena Bolto

Via Electronic Mail and U.S. Mail
April 30, 2026

Chief, Clean Water Branch
ATTN: Mr. Paul Schwartz
Water Protection Division
U.S. Environmental Protection Agency - Region 4
61 Forsyth Street, S.W.
Atlanta, GA 30303

RE: Clean Water Act Consent Decree 1:10cv 4039-SDG
April 30, 2026 1st Quarterly Report Submittal

Dear Mr. Schwartz:

As required by §IX. Reporting Requirement of the Consent Decree associated with the above referenced civil action, we are submitting the following document for your review and comment:

- **April 30, 2026 – 2026 1st Quarterly Report**

I certify under penalty of law that these documents and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering such information, the information submitted is, to the best of my knowledge and belief, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fines and imprisonment for knowing violations pursuant to CWA Section 309(c)(4).

If you have questions or comments regarding this submittal, please call me at 404-371-2174.

Respectfully,

Zachary L. Williams,
Chief Operating Officer and Executive Assistant
DeKalb County, Georgia

cc: Georgia EPD
Maria V. Houser, Director of Consent Decree and Environmental Compliance
Reginald Wells, Director, DWM
Tavaras Powell, Assistant Director, CMOM, DWM
Dora De Taboada, Assistant Director, Regulatory Compliance, DWM
E. Fitzgerald Veira, Troutman Pepper

1st Quarter 2026 Quarterly Report

January 1 to March 31, 2026
Civil Action No. 1:10cv4039 - SDG

DeKalb County
Department of Watershed Management

April 30, 2026

Table of Contents

Acronyms iii

Introduction 1

September 22, 2025 PFL Sites Remaining 3

Tables

Table 1. September 22, 2025 PFL Sites Adequate Fix Dates 3
Table 2. 1st Quarter 2026 Spills 5
Table 3. 1st Quarter 2026 Overflows 8
Table 4. 1st Quarter 2026 Building Backups 9
Table 5. 1st Quarter 2026 Lateral-Related Issues* 11

Attachments

Attachment A – Additional Documentary Support
Attachment B – Priority Fix List

Acronyms

CCTV	closed-circuit television
DWM	Department of Watershed Management (DeKalb County)
EPA	United States Environmental Protection Agency
EPD	Georgia Environmental Protection Division
FOG	Fats, Oils, and Grease
gal	gallon
I&I	infiltration and inflow
in	inch
LS	lift station
MCD	Modification to Consent Decree
PASARP	Priority Areas Sewer Assessment and Rehabilitation Program
PFL	Priority Fix List
ROW	Right of Way
SSO	Sanitary Sewer Overflow
WCTS	Wastewater Collection and Transmission System

Introduction

DeKalb County (hereafter, the "County") submits this 1st Quarter 2026 Quarterly Report in accordance with Section IX, Paragraph 56, of the Modification to Consent Decree (MCD) (Civil Action 1:10cv4039-SDG) to provide:

> "Each Quarterly SSO Report shall include the date, location, source, time reported, time stopped, estimated volume, receiving water (if any), cause, and actions taken to repair or otherwise resolve the cause of all SSOs occurring in the applicable three (3) month period in a tabulated electronic format."

1) "For each SSO, a determination of whether such SSO was caused by either a lack of Adequate Collection Capacity or Adequate Transmission Capacity, or by non-capacity reasons, and documentary support for the County's determination, including, where appropriate:"

    i) "If the County determines the cause of a particular SSO to be due to FOG, debris, any other sewer blockage, or infrastructure failure, the County shall provide photographic or video evidence supporting such determination or shall provide documentation of dry weather conditions at the time of the SSO based on information from the closest rainfall monitoring station to the SSO's location."

    ii) "If the County determines the cause of a particular SSO to be a lack of Adequate Collection Capacity or Adequate Transmission Capacity and the SSO occurred during a precipitation event, the County shall provide rainfall data from the closest rainfall monitoring station to the SSO's location; except, the County may presume an SSO is capacity-related if it documents in its Quarterly SSO Report, after investigating the cause of the SSO, that it was unable to locate any evidence of FOG, debris, any other sewer blockage, or infrastructure failure."

b) "For each SSO, the Initial or Additional Priority Area in which such SSO occurred, if applicable."

c) "An updated Priority Fix List of all Repeat SSO Locations, as provided in new Paragraph 35(j)."

d) "If the rehabilitation of any Repeat SSO Location was scheduled to be completed during the previous applicable three (3) month period, a statement that such work has or has not been completed. The County shall include a detailed written description of any such work not completed, the reasons for failing to complete such work, and the expected date of completion. If any missed deadline cannot be fully explained at the time the report is due, the County shall include a statement to that effect in the report."

During the reporting period (January 1 – March 31, 2026), DeKalb County Department of Watershed Management (DWM) documented 44 spills, 14 overflows, 11 building backups, and 165 lateral-related incidents.

A spill is defined as a discharge of wastewater from the Wastewater Collection and Transmission System (WCTS), or from a wastewater treatment facility caused by problems in the WCTS, that reaches waters of the United States or the State, including a prohibited bypass, but not including other discharges from a point source that is specified in the National Pollutant Discharge Elimination System permits. Spills for this reporting period are shown in Table 2.

An overflow is defined as release of wastewater from the WCTS, or from a wastewater treatment facility caused by problems in the WCTS that does not reach waters of the United States or the State. Overflows for this reporting period are shown in Table 3.

A building backup is defined as a wastewater backup into a building that is caused by blockages, malfunctions, or flow conditions in the WCTS. However, a wastewater backup into a building that is caused by a blockage or other malfunction of a private lateral or other piping or conveyance system that the County does not own or operate, is not a building backup. Building backups for this reporting period are shown in Table 4.

A lateral-related incident is defined as a Sanitary Sewer Overflow (SSO) caused by blockages or other issues located in that section of a private service lateral that is in the County's right-of-way (ROW). The County was asked on April 14, 2016, to begin tracking this information. Lateral-related issues for this reporting period are shown in Table 5.

SSOs by Others, for purposes of this reporting period, are SSOs that occur from a manhole on a sewer main owned and maintained by other utilities that traverses through a portion of the County. There were no SSOs by others for this reporting period.

Tables 2 through 5 document the incidents that occurred during this reporting period. Information reported for all types of incidents includes the following:

- Incident record ID number
- Date and time the incident was reported to DWM
- Gallons of sewage spilled (where applicable)
- Street address and city where the incident occurred
- Indication of what Priority Areas Sewer Assessment and Rehabilitation Program (PASARP) Area is applicable
- Cause of incident (see "Acronyms" following the "Spills" table [Table 1])
- Source/description of incident
- Capacity review (except for lateral-related incidents)—SSO determination; any documentary support (ID from closest rain gauge and rainfall measured)
- Date and time of flow restoration
- Actions taken to restore flow

Additional information specific to spills includes:

- Fish kill and/or major spill (> 10,000 gallons) designation
- Manhole/structure number (where applicable)
- Pipe size (diameter)
- Receiving water body, including tributary
- Date of applicable 24-hour notice and 5-day letter notifications (from DWM to Georgia Environmental Protection Division [EPD])
- Any additional follow-up required

Additional information specific to lateral-related issues includes:

- Indication of whether the WCTS main flows without blockage
- Indication of whether blockage is present in the lower lateral

As noted in the prior excerpt from the MCD, non-capacity-related SSOs are supported with data from the closest rain gauge indicating dry weather conditions. Alternatively, capacity-related SSOs can be documented with data from the closest rain gauge measuring a significant wet weather event. Selected SSOs that cannot be adequately supported only by rain gauge information will be further documented in Attachment A, as indicated, photos, closed-circuit television (CCTV) screenshots, dynamic model results, etc.

Attachment B provides an updated Priority Fix List showing the repeat SSO locations that have been added from the previous quarter as well as sites that the County has determined to be Adequately Fixed. Sites may be added to the Priority Fix List if multiple SSOs have occurred within a 500-foot radius in a 12-month period caused multiple times for capacity reasons or caused multiple times for non-capacity reasons. Eleven sites have been added to the Priority Fix List for this reporting period; all eleven of these sites are non-capacity related. During this quarter, the County also confirmed that an additional 10 sites have been Adequately Fixed as required by the MCD. One site, 3294 Lansbury Village Drive, was added to the PFL in the 4th Quarter 2025 Quarterly Report but has since been removed from the PFL. The County's regular quality control process identified that the first SSO initially mapped within 500 feet of 3294 Lansbury Village Drive was in fact located more than 500 feet from the second SSO location and, therefore, 3294 Lansbury Village Drive is not a PFL location as defined by the MCD. This site will not be included in future reporting.

September 22, 2025 PFL Sites In Progress

Rehabilitation of 14 Priority Fix List sites with an MCD deadline of September 22, 2025 MCD remain in progress are listed in Table 1. With the exception of PFL Site #21, the PFL sites are located in the Snapfinger Basin and are planned to be adequately fixed by interim measures[1] or planned trunk sewer projects. Full discussion of the reasons for delay and planned work are detailed in the 3rd Quarter 2025 Quarterly Report.

Table 1. September 22, 2025 PFL Sites Adequate Fix Dates

PFL Site #	Address	Anticipated Date of Adequate Fix
40	4124 Flakes Mill Road, Ellenwood	12/31/2027
42	4437 Wesleyan Pointe, Decatur	
43	4557 Meadow Creek Path, Lithonia	
95	3549 Panthersville Road	3/31/2031
27	3230 Boring Road, Decatur	12/31/2031
136	3391 Warbler Drive	
11	1615 Melanie Court	3/31/2034
21	2480 Miriam Lane	
26	3075 Thrasher Circle, Decatur	
90	2711 Fairlee Drive	
91	3037 Toney Drive	
59	217 Green Street	12/31/2027
160	255 South Columbia Drive	
12	1707 Childerlee Lane	6/30/2027

[1] Interim measures are temporary projects outside of existing MCD work and are intended to reduce or eliminate SSOs on a shorter time frame than sewer rehabilitation. They are also the subject of ongoing negotiations with EPA/EPD.

#12 - 1707 Childerlee Lane

1. Remaining Work

Hand tunnelling through rock of over 320 LF of 60-inch liner for installation of 24-inch sewer has started and 88 LF has been completed. Construction has also started on the vertical shaft for the downstream manhole of this segment with 21 VF completed. Upon completion of hand tunnelling, Phase 1B will begin. The contractor has a tunnel boring machine (TBM) in hand that will be used to bore over 2,600 LF of 66-inch liner for installation of 24-inch sewer main, including 400 LF under I-85. An additional 50 LF of 18-inch pipe will be installed to reach the PFL site. GDOT has reviewed the I-85 crossing submittals and requested the County withhold final submission until closer to Phase 1B so the permit does not expire before completion of construction.

Snapfinger Basin PFL Sites

The 13 PFL sites within the Snapfinger Basin shown to have not met the September 22, 2025 MCD deadline are sites impacted by capacity limitations in trunk sewers. The *Updated Plan and Request for Additional Time to Adequately Fix 14 Priority Fix List Locations Associated with the Snapfinger Basin* TM was submitted to EPA/EPD on March 10, 2025 and outlines in detail the project background, alternatives, and the proposed projects and timelines.

1. Remaining Work

Adequately fixing the PFL sites in Snapfinger Basin associated with trunk sewer capacity limitations include construction of trunk sewer projects and further buildout of the Snapfinger Advanced Wastewater Treatment Facility (AWTF), including the Influent Lift Station. Notice to Proceed for Shoal Creek Section 1 construction was provided to the contractor on March 30, 2026. This is the first of 103,300 LF of large diameter trunk sewer construction that is needed along with the associated easement acquisition, permitting, clearing, etc.

Upgrades will also be constructed at the Snapfinger AWTF including hydraulic buildout of the membrane bioreactor system (MBR) and the Influent Pump Station to increase capacity at the plant. The acceleration of these upgrades along with the construction of Shoal Creek Section 1 allows the County to adequately fix PFL sites 40, 42, and 43 by December 31, 2027 as opposed to previous schedule of June 30, 2029.

Additional interim measures include construction of temporary offline storage at PFL sites 59 and 160 that will adequately fix these sites by December 31, 2027 as opposed to previous schedule of June 30, 2037

1st Quarter 2026 SSO Tracking

Table 2. 1st Quarter 2026 Spills

	Date/Time		Type & Volume			Location			MH/Pipe		Cause/Source		Capacity Review		Water Body		Flow Restoration			Notifications		
Spill No.	Date Spill Reported to DWM (Revised)	Time Spill Reported to DWM (Revised)	Fish Kill	Major Spill	Estimated Quantity, gals (Revised)	Address of Spill	City	PASARP Area	Manhole/ Structure #	Pipe Size (in)	Cause	Source	SSO Determination	Documentary Support Rain Gauge, (Rainfall -in)	Receiving Stream or Waterbody	Tributary	Restoration Date	Restoration Time	Flow Restoration Action	24 hour Notice (Revised)	5 Day Letter	Additional Follow-up
1	1/5/2026	9:17	N	N	1,600	4323 Winters Chapel Road	Doraville	Not in a PASARP Area	340-S009	8	GR	Found manhole #18-340-s009 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGNANCY2, (0.00)	Nancy Creek	Unnamed	1/5/2026	10:37	Pressure washed the 8(in) sewer main 150(ft) to remove the grease blockage at 100(ft) which restored normal flow.	1/5/2026	1/9/2026	Cleaned up spill site. Placed public notification on spill site.
2	1/6/2026	9:07	N	N	760	4309 Memorial Drive	Decatur	A-SF3	251-S021	8	GR	Found manhole #15-351-s021 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGUSF9, (0.00)	Indian Creek	Unnamed	1/6/2026	9:45	Pressure washed the 8(in) sewer main 180(ft) to remove the grease blockage at 150(ft) which restored normal flow.	1/6/2026	1/9/2026	Cleaned up spill site. Placed public notification on spill site.
3	1/8/2026	9:12	N	N	1,760	3562 Habersham At Northlake	Tucker	I-IG12	210-S028	8	GR	Found manhole #18-210-s028 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGSFORK2, (0.00)	Henderson Mill Creek	Unnamed	1/8/2026	10:40	Pressure washed the 8(in) sewer main 50(ft) to remove the grease blockage at 30(ft) which restored normal flow.	1/8/2026	1/9/2026	Cleaned up spill site. Placed public notification on spill site.
4	1/11/2026	12:25	N	N	1,135	2853 Greenwillow Drive	Atlanta	I-IG14	208-S014	8	DB	Found manhole #18-208-s014 spilling into a storm drain, into the creek due to a debris (unknown) blockage in the 8(in) sewer main.	Non-Capacity	RGSFORK2, (0.00)	North Fork Peachtree Creek	Unnamed	1/11/2026	16:12	Pressure washed the 8(in) sewer main 160(ft) to remove the unknown debris blockage at 50(ft) which restored normal flow.	1/11/2026	1/16/2026	Cleaned up spill site. Placed public notification on spill site.
5	1/14/2026	8:43	N	N	1,325	4177 Northeast Expressway	Doraville	Not in a PASARP Area	294-S200	10	DB	Found manhole #18-294-s200 spilling into a storm drain, into the creek due to a debris (rocks) blockage in the 10(in) sewer main.	Non-Capacity	RGNFORK2, (0.00)	North Fork Peachtree Creek	Unnamed	1/14/2026	9:36	Pressure washed the 10(in) sewer main 20(ft) to remove the debris blockage at 5(ft) which restored normal flow.	1/14/2026	1/16/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
6	1/14/2026 (1/13/2026)	13:41 (09:32)	N	N	1,380	1380 Snapfinger Road	Decatur	I-SF2	166-S016	8	GR	Found manhole #15-166-s016 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGLSF1, (0.00)	Cobb Creek	N/A	1/14/2026	14:50	Pressure washed the 8(in) sewer main 100(ft) to remove the grease blockage which restored normal flow.	1/14/2026	1/16/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
7	1/16/2026	15:08	N	N	3,780	2116 Dering Circle	Atlanta	Not in a PASARP Area	235-S019	8	GR	Found manhole #18-235-s019 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGNFORK1, (0.00)	North Fork Peachtree Creek	Unnamed	1/16/2026	16:05	Pressure washed the 8(in) sewer main 316(ft) to remove the grease blockage at 315(ft) which restored normal flow.	1/17/2026	1/21/2026	CCTV and FOG education work orders already created from a previous spill at this location. Cleanup work order completed. Posted public notifications work order completed.
8	1/26/2026	13:18	N	N	135	1541 Burnstone Drive	Stone Mountain	Not in a PASARP Area	N/A	6	GR	Found row 6(in) cleanout surcharging with evidence of a spill into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGPB1, (0.08)	Pole Bridge Creek	Unnamed	1/26/2026	13:45	Pressure washed the 8(in) sewer main 397(ft) to remove the grease blockage at 302(ft) which restored normal flow.	1/26/2026	1/29/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
9	1/27/2026	13:34	N	N	1,520	3580 Larkspur Terrace	Decatur	I-SF2	188-S088	8	GR	Found manhole #15-188-s088 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGLSF1, (0.00)	Cobb Creek	Unnamed	1/27/2026	14:50	Pressure washed the 8(in) sewer main 151(ft) to remove the grease blockage at 15(ft) which restored normal flow.	1/27/2026	1/29/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
10	2/3/2026	12:23	N	Y	13,000	2247 Northlake Parkway	Tucker	I-IG12	210-S019	8	DB	Found manhole #18-210-s028, into the creek due to a debris (rocks) blockage in the 8(in) sewer main.	Non-Capacity	RGSFORK2, (0.00)	Henderson Mill Creek	Unnamed	2/3/2026	23:13	Pressure washed the 8(in) sewer main 80(ft) hitting the blockage at 75(ft) attempting to clear the blockage to restore normal flow but was unsuccessful.	2/4/2026	2/6/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
11	2/6/2026	15:42	N	N	1,620	4666 South Hope Spring Road	Stone Mountain	Not in a PASARP Area	225-S031	8	GR	Found manhole #15-225-s031 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGBAR3, (0.00)	Barbashela Creek	Unnamed	2/6/2026	17:03	Pressure washed the 8(in) sewer main 45(ft) to remove the grease blockage at 40(ft) which restored normal flow.	2/7/2026	2/11/2026	Cleaned up spill site. Placed public notification on spill site. a repair lateral work order was created (#26029760).
12	2/7/2026	15:57	N	N	2,500	1225 Columbia Drive	Decatur	I-SF3	200-P014	8	VAND/DB	Found manhole #15-200-p014 spilling into the storm drain, into the creek due to a debris/vandalism (wood and pieces of PVC) blockage in the public 8(in) sewer main.	Non-Capacity	RGSHO2, (0.00)	Shoal Creek	Unnamed	2/7/2026	18:00	Pressure washed the 8(in) sewer main 200(ft) to remove the debris/vandalism blockage at 100(ft) which restored normal flow.	2/8/2026	2/11/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. replace manhole or component work order completed. root control work order created for contractor.
13	2/8/2026	18:29	N	N	9,660	2449 East Club Drive	Atlanta	Not in a PASARP Area	239-S059	8	DB	Found manhole #18-239-s059 spilling into creek due to a debris (rags) blockage in the 8(in) sewer main.	Non-Capacity	RGSFORK3, (0.00)	North Fork Peachtree Creek	Unnamed	2/9/2026	14:41	Pressure washed the 8(in) sewer main 126(ft) to remove the debris (rags) blockage at 126(ft) which restored normal flow.	2/8/2026	2/13/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
14	2/9/2026	13:02	N	N	8,960	5185 Panola Industrial Boulevard	Decatur	Not in a PASARP Area	024-S036	10	UNK/DB	Found manhole #16-024-s036 spilling into creek due to an unknown debris blockage in the 10(in) sewer main.	Non-Capacity	RGLSF2, (0.00)	Panthers Branch Creek	Unnamed	2/9/2026	13:10	Pressure washed the 10(in) sewer main 315(ft) to remove the unknown debris blockage at 100(ft) which restored normal flow.	2/9/2026	2/11/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
15	2/11/2026	13:36	N	Y	10,440	2097 Vineyard Walk	Atlanta	Not in a PASARP Area	141-S002	8	GR	Found manhole #15-141-s002 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGINTREN1, (0.00)	Sugar Creek	N/A	2/11/2026	16:30	Pressure washed the 8(in) sewer main 91(ft) to remove the grease blockage which restored normal flow.	2/12/2026	2/13/2026	Cleanup work order completed. Posted public notifications work order completed. pipe replacement/repair is under contractor review.
16	2/12/2026	22:58	N	N	200	5616 Redan Road	Stone Mountain	Not in a PASARP Area	062-S002	8	GR	Found manhole #16-062-s002 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGUCKC1, (0.00)	Barbashela Creek	A	2/12/2026	23:20	Pressure washed the 8(in) sewer main 100(ft) to remove the grease blockage at 90(ft) which restored normal flow.	2/13/2026	2/13/2026	Cleanup work order completed. Posted public notifications work order completed. no gravity main repair work order created for the repairs made...have ops create work order.

	Date/Time		Type & Volume			Location			MH/Pipe		Cause/Source		Capacity Review		Water Body		Flow Restoration			Notifications		
Spill No.	Date Spill Reported to DWM (Revised)	Time Spill Reported to DWM (Revised)	Fish Kill	Major Spill	Estimated Quantity, gals (Revised)	Address of Spill	City	PASARP Area	Manhole/ Structure #	Pipe Size (in)	Cause	Source	SSO Determination	Documentary Support Rain Gauge, (Rainfall -in)	Receiving Stream or Waterbody	Tributary	Restoration Date	Restoration Time	Flow Restoration Action	24 hour Notice (Revised)	5 Day Letter	Additional Follow-up
17	2/13/2026	11:47	N	N	1,680	2097 Vineyard Walk	Atlanta	Not in a PASARP Area	141-S002	8	GR	Found manhole #15-141-s002 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGINTREN1, (0.00)	Sugar Creek	N/A	2/13/2026	12:15	Pressure washed the 8(in) sewer main 125(ft) to remove the grease blockage at 76(ft) which restored normal flow.	2/13/2026	2/18/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed.
18	2/17/2026	14:43	N	N	1,080	3400 Malone Drive	Chamblee	A-IG3	299-S268	8	GR	Found manhole #18-299-s268 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGNANCY3, (0.00)	Nancy Creek	Unnamed	2/17/2026	15:37	Pressure washed the 8(in) sewer main 100(ft) to remove the grease blockage at 40(ft) which restored normal flow.	2/18/2026	2/20/2026	Cleanup work order completed. Posted public notifications work order completed. CCTV and repair creek crossing work orders created.
19	2/18/2026	10:31	N	N	670	2313 Briarcliff Road	Atlanta	Not in a PASARP Area	153-S091	8	UNK/DB	Found manhole #18-153-s091 spilling into creek due to an unknown debris blockage in the 8(in) sewer main.	Non-Capacity	RGSFORK3, (0.00)	North Fork Peachtree Creek	Unnamed	2/18/2026	12:45	Pressure washed the 8(in) sewer main 120(ft) to remove the unknown debris blockage at 80(ft) which restored normal flow.	2/18/2026	2/20/2026	CCTV work order created for earnest/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
20	2/19/2026	18:09	N	N	1,960	5191 Chamblee Dunwoody Road	Dunwoody	Not in a PASARP Area	362-S061	8	BRK LN/STR	Found manhole #18-362-s061 surcharging due to a grease blockage in the 8(in) sewer main. upon further investigation, DWM crews found a defective pipe downstream of the spilling manhole.	Non-Capacity	RGBMC1, (0.04)	Nancy Creek	Tributary A	2/19/2026	19:47	Pressure washed the 8(in) sewer main 300(ft) to remove the grease blockage at 275(ft) which restored normal flow.	2/20/2026	2/24/2026	CCTV work order created for earnest/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
21	2/22/2026	10:36	N	N	4,140	1690 Chantilly Drive	Atlanta	Not in a PASARP Area	154-S014	8	DB	Found manhole #18-154-s014 spilling into the storm drain, into creek due to a debris(rags) blockage in the 8(in) sewer main.	Non-Capacity	RGSFORK3, (0.00)	North Fork Peachtree Creek	Unnamed	2/22/2026	11:45	Pressure washed the 8(in) sewer main 400(ft) to remove the debris (rags) blockage at 350(ft) which restored normal flow.	2/22/2026	2/24/2026	Cleaned up spill site. Placed public notification on spill site.
22	2/23/2026	10:17	N	N	3,500	2313 Briarcliff Road	Atlanta	Not in a PASARP Area	153-S091	8	UNK/DB	Found manhole #18-153-s091 spilling into creek due to an unknown debris blockage in the 8(in) sewer main.	Non-Capacity	RGSFORK3, (0.00)	North Fork Peachtree Creek	Unnamed	2/23/2026	13:12	Pressure washed the 8(in) sewer main 207(ft) to remove the unknown debris blockage at 206(ft) which restored normal flow.	2/18/2026	2/24/2026	Cleaned up spill site. Placed public notification on spill site.
23	2/24/2026	20:23	N	N	4,040	1123 Winding Branch Circle	Dunwoody	A-IG1	365-S015	8	GR	Found manhole #15-365-s015 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGBMC1, (0.00)	Marsh Creek	Unnamed	2/24/2026	23:45	Pressure washed the 8(in) sewer main 500(ft) to remove the grease blockage at 450(ft) which restored normal flow.	2/24/2026	2/27/2026	Cleaned up spill site. Placed public notification on spill site.
24	2/27/2026	13:15 (02:30)	N	N	9,348	2711 Fairlee Drive	Decatur	I-SF3	184-S002, 806	24	I&I	Rain water entered the sewer main during rain event causing manhole # 15-184-s002 & 184-s806 to spill into Shoal Creek.	Capacity	RGSHO2, (1.30)	Shoal Creek	N/A	2/27/2026	3:00	Checked upstream and downstream manholes. Removed all debris and disinfected the area. Posted spill signs for public notification.	2/27/2026	3/4/2026	Cleaned up spill site. Placed public notification on spill site.
25	2/27/2026 (2/26/2026)	10:16 (19:00)	N	N	1,366	1699 (1707) Childerlee Lane	Atlanta	Not in a PASARP Area	157-S026	8	I&I	Rain water entered the sewer main during rain event causing manholes #18-157-s026 to spill into North Fork Peachtree Creek. This information was retrieved from flow monitoring data.	Capacity	RGSFORK3, (1.26)	North Fork Peachtree Creek	Unnamed	2/27/2026	2:30	Checked upstream and downstream manholes. Removed all debris and disinfected the area. Posted spill signs for public notification.	2/27/2026	3/4/2026	Cleaned up spill site. Placed public notification on spill site.
26	2/27/2026	15:29 (03:00)	N	Y	291,392	2359 Harrington Drive	Decatur	Not in a PASARP Area	101-S073	30	I&I	Rain water entered the sewer main during rain event causing manholes #18-101-s073 to spill into South Fork Peachtree Creek. This information was retrieved from flow monitoring data.	Capacity	RGSFORK1, (1.49)	South Fork Peachtree Creek	N/A	2/27/2026	6:15	Checked upstream and downstream manholes. Removed all debris and disinfected the area. Posted spill signs for public notification.	2/28/2026	3/4/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
27	2/27/2026	10:13 (02:45)	N	Y	60,481	2925 Misty Waters Drive	Decatur	I-SF3	136-S057	24	I&I	Rain water entered the sewer main during rain event causing manhole #15-136-s057 to spill into Shoal Creek. This information was retrieved from flow monitoring data.	Capacity	RGINTREN1, (1.02)	Shoal Creek	N/A	2/27/2026	6:45	Checked upstream and downstream manholes. Removed all debris and disinfected the area. Posted spill signs for public notification.	3/2/2026	3/4/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
28	3/1/2026	20:30	N	N	700	5540 Redan Road	Stone Mountain	Not a PASARP Area	035-S095	8	GR	Found manhole #16-035-s095 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGUCKC1, (0.00)	Barbashela Creek	Unnamed	3/1/2026	22:35	Pressure washed the 8(in) sewer main 252(ft) to remove the grease blockage at 145(ft) which restored normal flow.	3/2/2026	3/4/2026	CCTV and FOG education work orders already created from a previous spill at this location. Cleanup work order completed. Posted public notifications work order completed.
29	3/5/2026	17:20	N	N	3,800	2357 North Peachtree Way	Dunwoody	Not a PASARP Area	310-S085	8	GR	Found manhole #6-310-s085 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGNEAST1, (0.00)	Nancy Creek	Unnamed	3/5/2026	20:30	Pressure washed the 8(in) sewer main 214(ft) to remove the grease blockage at 175(ft) which restored normal flow.	3/6/2026	3/10/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
30	3/6/2026	17:32	N	N	7,380	2323 North Peachtree Way	Dunwoody	Not a PASARP Area	370-S046	8	GR	Found manhole #18-370-s046 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGNEAST1, (0.24)	Nancy Creek	N/A	3/6/2026	19:35	Pressure washed the 8(in) sewer main 188(ft) to remove the grease blockage which restored normal flow.	3/7/2026	3/10/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
31	3/6/2026	16:51	N	N	900	4765 Big Valley Road	Stone Mountain	Not a PASARP Area	192-S061	8	GR	Found manhole #15-192-s061 surcharging causing a private 4(in) cleanout to spill into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGPB1, (0.32)	Snapfinger Creek	Unnamed	3/6/2026	18:21	Pressure washed the 8(in) sewer main 285(ft) to remove the grease blockage at 250(ft) which restored normal flow.	3/7/2026	3/10/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
32	3/6/2026	15:12	N	N	1,160	2135 American Industrial Way	Chamblee	Not a PASARP Area	308-S070	8	GR	Found manhole #18-308-s070 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGNANCY3, (0.00)	Nancy Creek	B	3/6/2026	16:10	Pressure washed the 8(in) sewer main 150(ft) to remove the grease blockage at 125(ft) which restored normal flow.	3/6/2026	3/10/2026	Cleaned up spill site. Placed public notification on spill site. a repair lateral work order was created (#26029760).
33	3/8/2026	17:58	N	N	2,820	1815 South Ponce De Leon Avenue	Atlanta	Not a PASARP Area	238-S202	8	GR	Found manhole #15-238-s202 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGSHO2, (0.90) *See Attachment A	South Fork Peachtree Creek	N/A	3/8/2026	22:40	Pressure washed the 8(in) sewer main 379(ft) to remove the grease blockage at 319(ft) which restored normal flow.	3/9/2026	3/10/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. replace manhole or component work order completed. root control work order created for contractor.

	Date/Time		Type & Volume			Location			MH/Pipe		Cause/Source		Capacity Review		Water Body		Flow Restoration			Notifications		
Spill No.	Date Spill Reported to DWM (Revised)	Time Spill Reported to DWM (Revised)	Fish Kill	Major Spill	Estimated Quantity, gals (Revised)	Address of Spill	City	PASARP Area	Manhole/ Structure #	Pipe Size (in)	Cause	Source	SSO Determination	Documentary Support Rain Gauge, (Rainfall -in)	Receiving Stream or Waterbody	Tributary	Restoration Date	Restoration Time	Flow Restoration Action	24 hour Notice (Revised)	5 Day Letter	Additional Follow-up
34	3/9/2026 (3/16/2026)	11:07 (12:00)	N	N	5,000	4809 Buford Highway	Chamblee	I-IG6	N/A	8	OUTSIDE CON	Found 4(in) row cleanout surcharging spilling intermittently into the storm drain, into the creek due to an outside contractor's utility bore into in the row lateral.	Non-Capacity	RGNFORK1, (0.79)	North Fork Peachtree Creek	Unnamed	3/19/2026	12:00	Rodded the row 4(in) cleanout 6(ft) to restore flow until repair can be made.	3/20/2026	3/23/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
35	3/11/2026	11:57	N	N	200	2333 North Peachtree Way	Dunwoody	Not a PASARP Area	370-S016	8	RT	Found manhole #18-370-s016 with evidence of a spill into Kingsley Lake due to a root blockage in the public 8(in) sewer main.	Non-Capacity	RGNEAST1, (0.00)	Kingsley Lake	Unnamed	3/11/2026	12:30	Root cut the 8(in) sewer main 20(ft) to remove the root blockage at 3(ft) which restored normal flow.	3/11/2026	3/11/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
36	3/13/2026	16:53	N	N	850	2751 Buford Highway	Atlanta	Not a PASARP Area	154-S200	8	GR	Found manhole #18-154-s200 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGSFORK3, (0.00)	North Fork Peachtree Creek	N/A	3/13/2026	20:30	Pressure washed the 8(in) sewer main 411(ft) to remove the grease blockage which restored normal flow.	3/14/2026	3/18/2026	Cleanup work order completed. Posted public notifications work order completed. pipe replacement/repair is under contractor review.
37	3/14/2026	13:11	N	N	200	3835 Raiders Ridge Drive	Lithonia	Not a PASARP Area	033-S026	8	GR	Found manhole #15-033-s026 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGSFPLNT1, (0.00)	Snapfinger Creek	N/A	3/14/2026	14:10	Pressure washed the 8(in) sewer main 326(ft) to remove the grease blockage which restored normal flow.	3/14/2026	3/18/2026	Cleanup work order completed. Posted public notifications work order completed. no gravity main repair work order created for the repairs made...have ops create work order.
38	3/13/2026	12:48	N	N	50	1659 Briarcliff Road	Atlanta	Not a PASARP Area	N/A	72	CRK BRK	Found 72x24(in) sewer main spilling due to a structural defect in the main.	Non-Capacity	RGSFORK3, (0.00)	South Fork Peachtree Creek	N/A	3/13/2026	15:30	Upon arrival, the flow receded below the defection portion of the 72x24(in) pipe. This receded flow stopped the spill. Several attempts to retain a contractor to weld the pipe has been initiated...they stated the pipe material is too thin.	3/17/2026	3/18/2026	CCTV work order created for Keith/CDPMT. Cleanup work order completed. Posted public notifications work order completed.
39	3/18/2026	13:00	N	N	100	100 Fairview Street	Decatur	Not a PASARP Area	N/A	12	BRK LN/STR	Found 12(in) sewer main spilling into creek due to a structural defect.	Non-Capacity	RGSHO2, (0.04)	Glendale Tributary	N/A	3/18/2026	14:05	Checked upstream and downstream manholes. Removed all debris and disinfected the area. Posted spill signs for public notification. DWM crews made emergency repairs to restore flow.	3/19/2026	3/23/2026	Cleanup work order completed. Posted public notifications work order completed. CCTV and repair creek crossing work orders created.
40	3/20/2026	12:42	N	N	8,235	352 Northern Avenue	Scottdale	Not a PASARP Area	011-S211	10	DB	Found manhole #18-011-s211 spilling into the creek due to a debris(rags) blockage in the 10(in) sewer main.	Non-Capacity	RGUSF9, (0.00)	Indian Creek	Unnamed	3/20/2026	3:45	Pressure washed the 10(in) sewer main 191(ft) to remove the debris (rags) blockage at 100(ft) which restored normal flow.	3/20/2026	3/23/2026	CCTV work order created for earnest/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
41	3/25/2026	11:59	N	N	2,480	1636 West Nancy Creek Drive	Atlanta	Not a PASARP Area	N/A	24	CRK BRK	Found 24(in) sewer main spilling into the creek due to a structural defect in the main.	Non-Capacity	RGNANCY3, (0.00)	Nancy Creek	North Fork Nancy Creek	3/25/2026	20:15	Checked upstream and downstream manholes, they were clear and flowing. Bypass pumps were set up which contained the spill until repairs can be made.	3/26/2026	3/30/2026	CCTV work order created for earnest/CDPMT. Cleanup work order completed. Posted public notifications work order completed. FOG education work order completed.
42	3/26/2026	14:45	N	N	5,500	1612 Avon Avenue	Tucker	Not a PASARP Area	166-S015	8	GR	Found manhole #18-166-s015 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGSFORK2, (0.00)	South Fork Peachtree Creek	Unnamed	3/26/2026	16:35	Pressure washed the 8(in) sewer main 291(ft) to remove the grease blockage at 250(ft) which restored normal flow.	3/26/2026	3/30/2026	Cleaned up spill site. Placed public notification on spill site.
43	3/26/2026	15:21	N	N	8,800	5388 Whitney Court	Stone Mountain	Not a PASARP Area	035-S112	8	GR	Found manhole #16-035-s112 spilling into the creek due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGUCKC1, (0.00)	Barbashela Creek	Unnamed	3/26/2026	19:03	Pressure washed the 8(in) sewer main 330(ft) to remove the grease blockage at 250(ft) which restored normal flow.	3/27/2026	3/30/2026	Cleaned up spill site. Placed public notification on spill site.
44	3/30/2026	15:23	N	N	3,280	1225 Columbia Drive	Decatur	I-SF3	200-P013	8	UNK/DB	Found private manhole #15-200-p013 spilling into the storm drain, into the creek due to an unknown debris blockage.	Non-Capacity	RGSHO2, (0.00)	Shoal Creek	Unnamed	3/30/2026	16:45	Pressure washed the 8(in) sewer main 70(ft) to remove the unknown debris blockage at 60(ft) which restored normal flow.	3/31/2026	4/3/2026	Cleaned up spill site. Placed public notification on spill site.

Acronyms

CC = County Contractor
BRK LN/STR = Broken Main, Broken Line, Broken Structure
CIPP = Cured-in-Place Pipe
CRK BRK = Creek Crossing Break
DB = Debris
FOG = Fats, Oils, and Grease
GR = Grease
In = inches
I&I = Inflow and Infiltration
LFT STN FLR = Lift Station Failure
MH = Manhole Issue/Damage
N/A = Not Applicable
Outside CON = Outside Contractor
PASARP = Priority Areas Sewer Assessment and Rehabilitation Program
PMP FLR = Pump Failure
RT = Roots
UNK = Unknown
VAND = Vandalism

Table 3. 1st Quarter 2026 Overflows

	Date/Time			Location			Cause/Source		Capacity Review		Flow Restoration			Results
Overflow No.	Date Overflow Reported to DWM	Time Overflow Reported to DWM	Quantity in Gallons	Address of Overflow	City	PASARP Area	Cause	Source/Additional Description	SSO Determination	Documentary Support Rain Gauge, (Rainfall -in)	Restoration Date	Restoration Time	Flow Restoration Action	Additional Follow-up
1	1/7/2026	16:58	30	100 Fairview Street	Decatur	Not in a PASARP Area	BRK LN/STR	Found evidence of an overflow caused by a structural defect in the 12(in) sewer main. A repair gravity main work order was created and repairs were completed on 1/12/2026.	Non-Capacity	RGSHO2, (0.00)	1/8/2026	12:00	DWM crews created a work order 26001991 for an emergency main repair. The permanent repairs were completed 1/12/2026.	Cleanup site completed.
2	1/29/2026	14:34	50	1906 Olde Village Run	Dunwoody	Not in a PASARP Area	RT	Found manhole #18-361-s049 surcharging causing a 4(in) private cleanout to overflow due to a root blockage in the 8(in) sewer main.	Non-Capacity	RGNANCY2, (0.00)	1/29/2026	21:15	Pressure washed the 8(in) sewer main 359(ft) to remove the root blockage at 350(ft) which restored normal flow.	Cleanup site completed.
3	2/10/226	9:29	20	2700 Smoketree Way	Atlanta	Not in a PASARP Area	CC/PMP FLR	Found evidence of an overflow due to a county contractor's bypass pump malfunction.	Non-Capacity	RGNFORK2, (0.00)	2/10/2026	10:20	County contractors made repair/adjustments to the bypass pump which contained the spill.	Cleanup site completed.
4	2/20/2026	13:36	100	2380 Elon Way	Decatur	A-IG5	GR	Found a private 4(in) cleanout overflowing due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGSFORK1, (0.00)	2/20/2026	14:30	Pressure washed the 8(in) sewer main 149(ft) to remove the grease blockage at 100(ft) which restored normal flow.	Cleanup site completed.
5	2/20/2026	9:34	300	3271 Panthersville Road	Decatur	Not in a PASARP Area	DB	Found 4(in) row cleanout surcharging with evidence of an overflow due to a debris (rags) blockage in the 10(in) sewer main.	Non-Capacity	RGBLUE2, (0.00)	2/20/2026	12:03	Pressure washed the 10(in) sewer main 65(ft) to remove the debris blockage which restored normal flow.	Cleanup site completed.
6	2/20/2026	14:30	22,050	5499 Flat Shoals Road	Decatur	Not in a PASARP Area	GR	Found a private 4(in) cleanout overflowing due to a grease blockage in the public 8(in) sewer main.	Non-Capacity	RGLSF2, (0.00)	2/23/2026	16:00	Pressure washed the 8(in) sewer main 276(ft) to remove the grease blockage at 125(ft) which restored normal flow.	Cleanup site completed.
7	2/25/2026	8:29	200	2775 East Ponce De Leon Avenue	Decatur	I-IG19	UNK/DB	Found manhole #15-249-s036 surcharging with evidence of an overflow due to an unknown blockage in the 8(in) sewer main.	Non-Capacity	RGSHO2, (0.00)	2/25/2026	12:00	Pressure washed the 8(in) sewer main 50(ft) to remove the unknown debris blockage at 6(ft) which restored normal flow.	Cleanup site completed.
8	2/27/2026	09:44 (03:00)	150	2480 Miriam Lane	Decatur	I-SF3	I&I	Found manhole #15-136-s012 with evidence of an overflow due to heavy inflow and infiltration from a rain event in the 24(in) sewer main.	Capacity	RGINTREN1, (1.02)	2/27/2026	6:00	crews actively monitored the area until containment was achieved which was after the rain and sewer main levels subsided.	Cleanup site completed.
9	3/9/2026	13:19	5,160	4776 Snapfinger Woods Drive	Decatur	Not a PASARP Area	UNK/DB	Found manhole #16-008-s400 surcharging with evidence of an overflow due to an unknown debris blockage in the 8(in) sewer main.	Non-Capacity	RGLSF1, (0.28)	3/9/2026	14:45	Pressure washed the 8(in) sewer main 140(ft) to remove the unknown debris blockage at 125(ft) which restored normal flow.	Cleanup site completed.
10	3/11/2026 (3/10/2026)	10:05 (13:30)	1,064	1078 Beech Haven Road	Atlanta	Not a PASARP Area	OTH	Found evidence of an overflow due to infiltration from a water main break at 1262 Citadel Drive on 3/10/2026	Capacity	RGSFORK3, (0.24)	3/10/2026	13:45	Water crews shut water valve off on 3/10/2026 to contain and make repairs to water main.	Cleanup site completed.
11	3/19/2026	9:13	50	2381 Cove Lake Way	Lithonia	Not a PASARP Area	GR	Found manhole #16-057-s009 with evidence of an overflow due to a grease blockage in the 8(in) sewer main.	Non-Capacity	RGPB1, (0.00)	3/19/2026	10:00	Pressure washed the 8(in) sewer main 72(ft) to remove the grease blockage at 34(ft) which restored normal flow.	Cleanup site completed.
12	3/20/2026	12:33	10	1436 Edinburgh Drive	Tucker	Not a PASARP Area	OTH	Found evidence of an overflow from the 8(in) sewer main due to a loose fernco connection. The loose connection allowed sewer to escape the pipe.	Non-Capacity	RGSFORK2, (0.00)	3/20/2026	13:00	DWM crews tightened the fernco connection which stopped the overflow.	Cleanup site completed.
13	3/25/2026	16:42	25	4295 Glenwood Road	Decatur	I-SF2	UNK	Found manhole #15-165-s017 with evidence of an overflow due to an unknown blockage in the 24(in) sewer main.	Non-Capacity	RGLSF1, (0.00)	3/25/2026	17:45	Upon arrival, DWM crews checked the upstream and downstream manholes, they were clear and flowing. Crews cleaned up the area and applied disinfectant around the manhole.	Cleanup site completed.
14	3/26/2026	15:59	8	2004 Breckenridge Drive	Atlanta	I-IG14	GR	Found manhole #18-192-s086 with evidence of an overflow due to a grease blockage in the 8(in) sewer main.	Non-Capacity	RGSFORK2, (0.00)	3/26/2026	22:00	Pressure washed the 8(in) sewer main 150(ft) to remove the grease blockage which restored normal flow.	Cleanup site completed.

Table 4. 1st Quarter 2026 Building Backups

	Date/Time			Location			Cause/Source		Capacity Review		Flow Restoration		
Building Back-up No.	Date Building Back-up Reported to DWM (Revised)	Time Building Back-up Report to DWM	Quantity in Gallons (est.)	Address of Building Back-up	City	PASARP Area	Cause	Source/Additional Description	SSO Determination	Documentary Support Rain Gauge, (Rainfall -in)	Restoration Date	Restoration Time	Flow Restoration Action
1	1/7/2025	15:07	5	1641 Canopy Chase	Atlanta	A-IG3	CC/OTH	County contractors caused a building backup while pressure washing the 8(in) sewer main.	Non-Capacity	RGNANCY3, (0.00)	1/7/2026	15:07	County contractors stopped pressure washing which stopped the building backup.
2	1/29/2026	14:34	5	1906 Olde Village Run	Dunwoody	Not in a PASARP Area	RT	Found a building backup due to a root blockage in the 8(in) sewer main.	Non-Capacity	RGNEAST1, (0.00)	1/29/2026	21:15	Pressure washed the 8(in) sewer main 359(ft) to remove the root blockage at 350(ft) to restore normal flow.
3	2/20/2026	13:38	100	2380 Elon Way	Decatur	A-IG5	GR	Found a building backup due to a grease blockage in the 8(in) sewer main.	Non-Capacity	RGSFORK1, (0.00)	2/20/2026	14:00	Pressure washed the 8(in) sewer main 149(ft) to remove the grease blockage at 100(ft) to restore normal flow.
4	2/25/2026	17:32	10	5692 Boggs Drive	Stone Mountain	A-PB1	CC	Found sewer backing up into the home due to a county contractor pressure washing/cleaning the sewer main.	Non-Capacity	RGBAR1, (0.00)	2/25/2026	18:30	Crews checked the upstream and downstream manholes, they were clear and flowing. County contractors stopped pressure cleaning to stop the building backup.
5	2/25/2026	19:32	60	5686 Boggs Drive	Stone Mountain	A-PB1	CC	Found sewer backing up into the home due to a county contractor pressure washing/cleaning the sewer main.	Non-Capacity	RGBAR1, (0.00)	2/25/2026	19:45	Crews checked the upstream and downstream manholes, they were clear and flowing. County contractors stopped pressure cleaning to stop the building backup.
6	2/26/2026	22:03	20	850 Meadow Rock Drive	Stone Mountain	Not in a PASARP Area	GR	Found a building backup due to a grease blockage in the 8(in) sewer main.	Non-Capacity	RGBAR1, (1.77)	2/26/2026	23:00	Pressure washed the 8(in) sewer main 350(ft) to remove the grease blockage at 245(ft) to restore normal flow.
7	2/26/2026	22:08	1,000	844 Meadow Rock Drive	Stone Mountain	Not in a PASARP Area	GR	Found a building backup due to a grease blockage in the 8(in) sewer main.	Non-Capacity	RGBAR1, (1.77)	2/26/2026	23:00	Pressure washed the 8(in) sewer main 350(ft) to remove the grease blockage at 245(ft) to restore normal flow.
8	3/2/2026	10:10	70	4885 Chamblee Tucker Road	Tucker	Not a PASARP Area	RT	Found a building backup due to a root blockage in the 8(in) sewer main.	Non-Capacity	RGNFORK6, (0.00)	3/2/2026	11:00	Root cut the 8(in) sewer main 200(ft) to remove the Root blockage at 175(ft) which restored normal flow.
9	3/18/2026	12:44	10	3193 Mcafee Road	Decatur	I-SF3	CC	Found sewer backing up into the home due to a county contractor pressure washing/cleaning the sewer main.	Non-Capacity	RGINTREN1, (0.00)	3/18/2026	13:08	Crews checked the upstream and downstream manholes, they were clear and flowing. County contractors (EWSG) stopped pressure cleaning to stop the spill. EWSG cleaned up the building backup.

	Date/Time			Location			Cause/Source		Capacity Review		Flow Restoration		
Building Back-up No.	Date Building Back-up Reported to DWM (Revised)	Time Building Back-up Report to DWM	Quantity in Gallons (est.)	Address of Building Back-up	City	PASARP Area	Cause	Source/Additional Description	SSO Determination	Documentary Support Rain Gauge, (Rainfall -in)	Restoration Date	Restoration Time	Flow Restoration Action
10	3/19/2026	9:13	50	2398 Cove Lake Way	Lithonia	Not a PASARP Area	GR	Found a building backup due to a grease blockage in the 8(in) sewer main.	Non-Capacity	RGPB1, (0.00)	3/19/2026	10:00	Pressure washed the 8(in) sewer main to remove the grease blockage to restore normal flow.
11	3/31/2026	15:29	30	2156 Oakawana Road	Atlanta	A-IG5	CC	Found sewer backing up into the home due to a county contractor (Vortex/FFAR) pressure washing/cleaning the sewer main.	Non-Capacity	RGSFORK2, (0.00)	3/31/2026	17:30	Crews checked the upstream and downstream manholes, they were clear and flowing. County contractors stopped pressure cleaning to stop the building backup.

Table 5. 1st Quarter 2026 Lateral-Related Issues*

	Date/Time		Location	Cause/Source			Flow Restoration		
Lateral Issue No.	Date Reported to DWM	Time Reported to DWM	Address	Is the WCTS Main Flowing without Blockage?	Is there a Blockage in the Lower Lateral?	Source/Additional Description	Restoration Date	Restoration Time	Flow Restoration Actions
1	1/1/2026	13:55	900 Louisa Lane, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	1/1/2026	15:25	Blockage removed from private lateral to restore flow
2	1/1/2026	16:45	4202 Hanes Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/1/2026	17:45	Blockage removed from private lateral to restore flow
3	1/2/2026	14:00	877 Brownwood Avenue, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	1/2/2026	15:00	Blockage removed from private lateral to restore flow
4	1/3/2026	17:35	3510 Spring Circle, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/3/2026	18:55	Blockage removed from private lateral to restore flow
5	1/4/2026	12:45	3828 West Wood Path, Stone Mountain	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/4/2026	13:00	Flow restored to lateral and overflow area cleaned
6	1/5/2026	14:30	104 Warren Street, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	1/5/2026	14:45	Blockage removed from private lateral to restore flow
7	1/5/2026	15:30	2644 Preston Drive, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/5/2026	15:45	Flow restored to lateral and overflow area cleaned
8	1/5/2026	18:05	982 Dunstan Lane, Stone Mountain	Yes	Yes	Blockage removed from private lateral to restore flow	1/5/2026	19:05	Blockage removed from private lateral to restore flow
9	1/6/2026	9:10	4309 Memorial Drive, Decatur	No	Yes	Blockage removed from WCTS and lateral to restore flow	1/6/2026	9:20	Blockage removed from WCTS and lateral to restore flow
10	1/6/2026	10:30	1226 Druid Knoll Drive, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	1/6/2026	11:30	Blockage removed from private lateral to restore flow
11	1/6/2026	11:00	6283 Robins Trace, Stone Mountain	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/6/2026	11:20	Flow restored to lateral and overflow area cleaned
12	1/7/2026	12:00	1054 Oxford Road, Atlanta	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/7/2026	12:30	Flow restored to lateral and overflow area cleaned
13	1/7/2026	16:30	100 Fairview Street, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/7/2026	16:45	Flow restored to lateral and overflow area cleaned
14	1/7/2026	18:00	4404 Old Georgetown Trail, Dunwoody	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/7/2026	18:30	Flow restored to lateral and overflow area cleaned
15	1/8/2026	9:15	2743 Eastwood Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/8/2026	9:45	Blockage removed from private lateral to restore flow
16	1/9/2026	17:00	5138 Longview Run, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/9/2026	18:00	Blockage removed from private lateral to restore flow
17	1/9/2026	18:30	3637 Salem Drive, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	1/9/2026	19:00	Blockage removed from private lateral to restore flow
18	1/11/2026	12:10	5116 Ashmont Court, Dunwoody	Yes	Yes	Blockage removed from private lateral to restore flow	1/11/2026	13:10	Blockage removed from private lateral to restore flow
19	1/11/2026	14:00	2853 Greenwillow Dr, Atlanta	No	Yes	Blockage removed from WCTS and lateral to restore flow	1/11/2026	14:30	Blockage removed from WCTS and lateral to restore flow
20	1/11/2026	19:40	3020 Francine Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/11/2026	20:10	Blockage removed from private lateral to restore flow
21	1/11/2026	21:00	1823 Ravenwood Way, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	1/11/2026	21:30	Blockage removed from private lateral to restore flow
22	1/12/2026	10:30	2138 Luray Court, Dunwoody	Yes	Yes	Blockage removed from private lateral to restore flow	1/12/2026	11:30	Blockage removed from private lateral to restore flow
23	1/12/2026	0:30	4197 Wesley Hall Lane, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/12/2026	13:30	Blockage removed from private lateral to restore flow
24	1/12/2026	15:30	7760 Hansel Ln, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	1/12/2026	16:00	Blockage removed from private lateral to restore flow
25	1/13/2026	18:00	1832 Atherton Drive, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/13/2026	18:15	Flow restored to lateral and overflow area cleaned
26	1/15/2026	10:00	1158 Houston Mill Road, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	1/15/2026	14:30	Blockage removed from private lateral to restore flow
27	1/15/2026	12:00	4779 Andalusia Trail, Doraville	Yes	Yes	Blockage removed from private lateral to restore flow	1/15/2026	13:00	Blockage removed from private lateral to restore flow
28	1/16/2026	16:30	1821 Angelique Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/16/2026	17:30	Blockage removed from private lateral to restore flow
29	1/16/2026	13:00	2315 Chamblee Tucker Rd, Chamblee	No	Yes	Blockage removed from WCTS and lateral to restore flow	1/16/2026	15:00	Blockage removed from WCTS and lateral to restore flow

	Date/Time		Location	Cause/Source			Flow Restoration		
Lateral Issue No.	Date Reported to DWM	Time Reported to DWM	Address	Is the WCTS Main Flowing without Blockage?	Is there a Blockage in the Lower Lateral?	Source/Additional Description	Restoration Date	Restoration Time	Flow Restoration Actions
30	1/16/2026	15:50	2116 Dering Circle, Atlanta	No	Yes	Blockage removed from private lateral to restore flow	1/16/2026	16:05	Blockage removed from private lateral to restore flow
31	1/17/2026	10:30	1924 Cliff Valley Way, Atlanta	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/17/2026	11:00	Flow restored to lateral and overflow area cleaned
32	1/17/2026	16:56	1754 Vickers Circle, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/17/2026	18:10	Blockage removed from private lateral to restore flow
33	1/17/2026	19:50	3988 Chimney Ridge Drive, Ellenwood	Yes	Yes	Blockage removed from private lateral to restore flow	1/17/2026	20:20	Blockage removed from private lateral to restore flow
34	1/17/2026	21:00	608 Rockborough Ct, Stone Mountain	Yes	Yes	Blockage removed from private lateral to restore flow	1/17/2026	21:30	Blockage removed from private lateral to restore flow
35	1/19/2026	17:00	1859 West Nancy Creek Drive, Chamblee	Yes	Yes	Blockage removed from private lateral to restore flow	1/19/2026	18:00	Blockage removed from private lateral to restore flow
36	1/19/2026	21:00	4541 Devonshire Road, Dunwoody	Yes	Yes	Blockage removed from private lateral to restore flow	1/19/2026	22:00	Blockage removed from private lateral to restore flow
37	1/20/2026	11:30	1308 Oaklawn Avenue, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	1/20/2026	12:00	Blockage removed from private lateral to restore flow
38	1/20/2026	16:00	1060 3rd Street, Stone Mountain	Yes	Yes	Blockage removed from private lateral to restore flow	1/20/2026	17:00	Blockage removed from private lateral to restore flow
39	1/20/2026	19:30	240 West Benson Street, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/20/2026	21:30	Blockage removed from private lateral to restore flow
40	1/21/2026	10:00	4571 Sims Court, Tucker	Yes	Yes	Blockage removed from private lateral to restore flow	1/21/2026	11:00	Blockage removed from private lateral to restore flow
41	1/23/2026	9:30	3167 Kingfisher Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/23/2026	10:00	Blockage removed from private lateral to restore flow
42	1/23/2026	18:20	3568 Pin Oak Circle, Doraville	Yes	Yes	Blockage removed from private lateral to restore flow	1/23/2026	19:20	Blockage removed from private lateral to restore flow
43	1/23/2026	18:30	5321 Winslow Crossing N, Lithonia	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/23/2026	18:45	Flow restored to lateral and overflow area cleaned
44	1/23/2026	21:15	2789 Hillvale Cove Way, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	1/23/2026	22:00	Blockage removed from private lateral to restore flow
45	1/24/2026	13:50	3708 Salem Hills Court, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	1/24/2026	15:05	Blockage removed from private lateral to restore flow
46	1/24/2026	16:05	3212 Cates Avenue, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	1/24/2026	16:30	Blockage removed from private lateral to restore flow
47	1/25/2026	16:15	481 Rockborough Terrace, Stone Mountain	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/25/2026	16:25	Flow restored to lateral and overflow area cleaned
48	1/26/2026	8:30	3264 Allison Circle, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/26/2026	8:45	Flow restored to lateral and overflow area cleaned
49	1/26/2026	11:25	513 Rays Road, Stone Mountain	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/26/2026	11:40	Flow restored to lateral and overflow area cleaned
50	1/26/2026	13:30	1541 Burnstone Drive, Stone Mountain	No	Yes	Blockage removed from WCTS and lateral to restore flow	1/26/2026	13:45	Blockage removed from WCTS and lateral to restore flow
51	1/27/2026	13:10	912 Sycamore Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/27/2026	14:00	Blockage removed from private lateral to restore flow
52	1/27/2026	14:30	4512 Sharon Valley Court, Dunwoody	Yes	Yes	Blockage removed from private lateral to restore flow	1/27/2026	15:00	Blockage removed from private lateral to restore flow
53	1/27/2026	18:20	6392 Ariaal Drive, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	1/27/2026	18:30	Blockage removed from private lateral to restore flow
54	1/28/2026	8:30	225 West Ponce De Leon Avenue, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/28/2026	9:00	Flow restored to lateral and overflow area cleaned
55	1/28/2026	10:50	4425 Cypress Ridge Ln, Stone Mountain	Yes	Yes	Blockage removed from private lateral to restore flow	1/28/2026	12:20	Blockage removed from private lateral to restore flow
56	1/29/2026	9:20	5321 Winslow Crossing N, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	1/29/2026	10:20	Blockage removed from private lateral to restore flow
57	1/29/2026	15:30	4978 Dantel Way, Stone Mountain	Yes	Yes	Blockage removed from private lateral to restore flow	1/29/2026	15:45	Blockage removed from private lateral to restore flow
58	1/29/2026	15:40	2265 Miriam Lane, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/29/2026	16:20	Blockage removed from private lateral to restore flow
59	1/29/2026	16:30	121 Maxwell Street, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/29/2026	17:00	Blockage removed from private lateral to restore flow

	Date/Time		Location	Cause/Source			Flow Restoration		
Lateral Issue No.	Date Reported to DWM	Time Reported to DWM	Address	Is the WCTS Main Flowing without Blockage?	Is there a Blockage in the Lower Lateral?	Source/Additional Description	Restoration Date	Restoration Time	Flow Restoration Actions
60	1/30/2026	12:15	2840 Duncan Drive, Chamblee	Yes	Yes	Blockage removed from private lateral to restore flow	1/30/2026	13:45	Blockage removed from private lateral to restore flow
61	1/30/2026	13:00	1060 3rd Street, Stone Mountain	Yes	Yes	Flow restored to lateral and overflow area cleaned	1/30/2026	13:15	Flow restored to lateral and overflow area cleaned
62	1/30/2026	14:45	962 Hunting Valley Place, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	1/30/2026	15:15	Blockage removed from private lateral to restore flow
63	1/30/2026	16:00	1824 Singer Way, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	1/30/2026	16:30	Blockage removed from private lateral to restore flow
64	2/1/2026	15:30	4063 Glenwood Road, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/1/2026	15:45	Blockage removed from private lateral to restore flow
65	2/2/2026	9:45	1131 Country Lane, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	2/2/2026	10:30	Blockage removed from private lateral to restore flow
66	2/2/2026	15:45	3438 Summitridge Drive, Doraville	Yes	Yes	Blockage removed from private lateral to restore flow	2/2/2026	16:00	Blockage removed from private lateral to restore flow
67	2/3/2026	10:16	2547 Garrett Circle, Doraville	Yes	Yes	Flow restored to lateral and overflow area cleaned	2/3/2026	15:30	Flow restored to lateral and overflow area cleaned
68	2/4/2026	11:30	4512 Sharon Valley Court, Dunwoody	Yes	Yes	Blockage removed from private lateral to restore flow	2/4/2026	12:30	Blockage removed from private lateral to restore flow
69	2/6/2026	12:00	1754 East Clifton Road, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	2/6/2026	12:30	Blockage removed from private lateral to restore flow
70	2/6/2026	14:30	129 Lockwood Terrace, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/6/2026	15:00	Blockage removed from private lateral to restore flow
71	2/6/2026	13:30	3418 Rocky Pine Court, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	2/6/2026	14:30	Blockage removed from private lateral to restore flow
72	2/6/2026	16:15	4666 South Hope Springs Road, Stone Mountain	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/6/2026	16:30	Blockage removed from WCTS and lateral to restore flow
73	2/7/2026	18:30	2449 East Club Drive, Atlanta	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/7/2026	19:30	Blockage removed from WCTS and lateral to restore flow
74	2/9/2026	13:00	2576 River Oak Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/9/2026	15:00	Blockage removed from private lateral to restore flow
75	2/10/2026	10:45	1670 Scott Boulevard, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/10/2026	12:10	Blockage removed from private lateral to restore flow
76	2/11/2026	11:00	1855 Briarlake Circle, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/11/2026	12:00	Blockage removed from private lateral to restore flow
77	2/11/2026	12:30	2326 Echo Hills Circle, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	2/11/2026	13:00	Blockage removed from private lateral to restore flow
78	2/11/2026	16:15	2097 Vineyard Walk, Atlanta	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/11/2026	16:30	Blockage removed from WCTS and lateral to restore flow
79	2/11/2026	18:11	225 West Ponce De Leon Avenue, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	2/12/2026	9:00	Flow restored to lateral and overflow area cleaned
80	2/11/2026	19:30	3744 Bay Shore Court, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	2/11/2026	20:30	Blockage removed from private lateral to restore flow
81	2/12/2026	10:00	2289 Starline Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/12/2026	10:15	Blockage removed from private lateral to restore flow
82	2/12/2026	13:30	2402 Rhineland Court, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	2/12/2026	15:30	Blockage removed from private lateral to restore flow
83	2/12/2026	11:20	5616 Redan Road, Stone Mountain	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/12/2026	11:30	Blockage removed from WCTS and lateral to restore flow
84	2/13/2026	12:00	4348 Rockbridge Road, Stone Mountain	Yes	Yes	Flow restored to lateral and overflow area cleaned	2/13/2026	12:15	Flow restored to lateral and overflow area cleaned
85	2/14/2026	13:00	2275 Leafmore Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/14/2026	13:15	Blockage removed from private lateral to restore flow
86	2/14/2026	14:40	1384 Emory Road, Atlanta	Yes	Yes	Flow restored to lateral and overflow area cleaned	2/14/2026	14:55	Flow restored to lateral and overflow area cleaned
87	2/16/2026	13:10	841 Longfellow Court, Stone Mountain	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/16/2026	15:10	Blockage removed from WCTS and lateral to restore flow
88	2/16/2026	14:30	3212 Cates Avenue, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	2/16/2026	15:30	Blockage removed from private lateral to restore flow
89	2/16/2026	9:30	2805 North Thompson Road, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	2/16/2026	10:30	Blockage removed from private lateral to restore flow

	Date/Time		Location	Cause/Source			Flow Restoration		
Lateral Issue No.	Date Reported to DWM	Time Reported to DWM	Address	Is the WCTS Main Flowing without Blockage?	Is there a Blockage in the Lower Lateral?	Source/Additional Description	Restoration Date	Restoration Time	Flow Restoration Actions
90	2/17/2026	12:20	407 West Ponce De Leon Avenue, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/17/2026	13:20	Blockage removed from private lateral to restore flow
91	2/17/2026	17:10	1558 Avon Ave, Tucker	Yes	Yes	Blockage removed from private lateral to restore flow	2/17/2026	17:30	Blockage removed from private lateral to restore flow
92	2/18/2026	10:45	2313 Briarcliff Road, Atlanta	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/18/2026	11:15	Blockage removed from WCTS and lateral to restore flow
93	2/18/2026	9:00	246 2nd Avenue, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/18/2026	21:30	Blockage removed from private lateral to restore flow
94	2/20/2026	12:25	328 West College Avenue, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	2/20/2026	12:40	Flow restored to lateral and overflow area cleaned
95	2/20/2026	13:20	2380 Elon Way, Decatur	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/20/2026	13:40	Blockage removed from WCTS and lateral to restore flow
96	2/20/2026	17:30	4133 Church Street, Clarkston	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/20/2026	22:00	Blockage removed from WCTS and lateral to restore flow
97	2/20/2026	16:30	3438 Moreland Avenue, Conley	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/20/2026	18:00	Blockage removed from WCTS and lateral to restore flow
98	2/21/2026	13:00	2377 Midvale Circle, Tucker	Yes	Yes	Blockage removed from private lateral to restore flow	2/21/2026	13:30	Blockage removed from private lateral to restore flow
99	2/22/2026	12:50	3707 Satellite Boulevard, Ellenwood	Yes	Yes	Blockage removed from private lateral to restore flow	2/22/2026	13:20	Blockage removed from private lateral to restore flow
100	2/23/2026	10:00	7524 Stone Creek Path, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	2/23/2026	10:15	Blockage removed from private lateral to restore flow
101	2/23/2026	10:25	1492 Druid Valley Drive, Atlanta	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/23/2026	10:45	Blockage removed from WCTS and lateral to restore flow
102	2/23/2026	15:50	1558 Avon Avenue, Tucker	Yes	Yes	Blockage removed from private lateral to restore flow	2/23/2026	16:20	Blockage removed from private lateral to restore flow
103	2/23/2026	18:05	129 Lockwood Terrace, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	2/23/2026	18:35	Flow restored to lateral and overflow area cleaned
104	2/25/2026	13:15	2204 Oakawana Road, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	2/25/2026	13:45	Blockage removed from private lateral to restore flow
105	2/25/2026	16:45	2229 Marann Drive, Atlanta	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/25/2026	17:10	Blockage removed from WCTS and lateral to restore flow
106	2/26/2026	10:00	809 Derrydown Way, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/26/2026	12:00	Blockage removed from private lateral to restore flow
107	2/26/2026	10:30	844 Meadow Rock Drive, Stone Mountain	No	Yes	Blockage removed from WCTS and lateral to restore flow	2/26/2026	10:45	Blockage removed from WCTS and lateral to restore flow
108	2/26/2026	12:00	148 Feld Avenue, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	2/26/2026	13:15	Blockage removed from private lateral to restore flow
109	2/26/2026	14:30	2908 Saint Patrick Street, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	2/26/2026	15:00	Blockage removed from private lateral to restore flow
110	2/26/2026	23:56	4798 Olde Village Lane, Dunwoody	Yes	Yes	Flow restored to lateral and overflow area cleaned	2/27/2026	0:47	Flow restored to lateral and overflow area cleaned
111	2/27/2026	13:30	1615 Melanie Court, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	2/27/2026	13:45	Flow restored to lateral and overflow area cleaned
112	2/27/2026	19:50	1384 Emory Road, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	2/27/2026	20:20	Blockage removed from private lateral to restore flow
113	2/27/2026	20:15	3707 Satellite Boulevard, Ellenwood	Yes	Yes	Blockage removed from private lateral to restore flow	2/27/2026	20:45	Blockage removed from private lateral to restore flow
114	3/1/2026	19:50	1275 Reilly Lane, Clarkston	Yes	Yes	Blockage removed from private lateral to restore flow	3/1/2026	20:20	Blockage removed from private lateral to restore flow
115	3/1/2026	21:35	5540 Redan Road, Stone Mountain	No	Yes	Blockage removed from WCTS and lateral to restore flow	3/1/2026	22:05	Blockage removed from WCTS and lateral to restore flow
116	3/2/2026	10:45	3174 Lynnray Drive, Doraville	Yes	Yes	Blockage removed from private lateral to restore flow	3/2/2026	11:15	Blockage removed from private lateral to restore flow
117	3/3/2026	12:21	2312 Belmont Drive, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	3/3/2026	12:36	Flow restored to lateral and overflow area cleaned
118	3/3/2026	11:30	2817 Thornridge Drive, Doraville	Yes	Yes	Blockage removed from private lateral to restore flow	3/3/2026	12:30	Blockage removed from private lateral to restore flow
119	3/3/2026	12:30	4733 Pine Acres Court, Dunwoody	Yes	Yes	Blockage removed from private lateral to restore flow	3/3/2026	13:30	Blockage removed from private lateral to restore flow

	Date/Time		Location	Cause/Source			Flow Restoration		
Lateral Issue No.	Date Reported to DWM	Time Reported to DWM	Address	Is the WCTS Main Flowing without Blockage?	Is there a Blockage in the Lower Lateral?	Source/Additional Description	Restoration Date	Restoration Time	Flow Restoration Actions
120	3/3/2026	13:30	3594 Old Chamblee Tucker Rd, Doraville	Yes	Yes	Blockage removed from private lateral to restore flow	3/3/2026	14:00	Blockage removed from private lateral to restore flow
121	3/3/2026	15:00	4490 Redwood Street, Doraville	Yes	Yes	Blockage removed from private lateral to restore flow	3/3/2026	16:00	Blockage removed from private lateral to restore flow
122	3/4/2026	9:25	4543 Garden Hills Drive, Stone Mountain	Yes	Yes	Blockage removed from private lateral to restore flow	3/4/2026	12:25	Blockage removed from private lateral to restore flow
123	3/4/2026	13:00	1510 Summerford Court, Dunwoody	Yes	Yes	Blockage removed from private lateral to restore flow	3/4/2026	14:00	Blockage removed from private lateral to restore flow
124	3/5/2026	17:08	2132 Tudor Castle Circle, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/5/2026	17:08	Blockage removed from private lateral to restore flow
125	3/5/2026	20:00	2357 North Peachtree Way, Dunwoody	No	Yes	Blockage removed from WCTS and lateral to restore flow	3/5/2026	20:30	Blockage removed from WCTS and lateral to restore flow
126	3/7/2026	23:30	4132 East Kasselryne Court, Tucker	No	Yes	Blockage removed from WCTS and lateral to restore flow	3/8/2026	3:00	Blockage removed from WCTS and lateral to restore flow
127	3/8/2026	16:40	1275 Reilly Lane, Clarkston,	Yes	Yes	Blockage removed from private lateral to restore flow	3/8/2026	17:10	Blockage removed from private lateral to restore flow
128	3/9/2026	13:30	4601 Snapfinger Woods Dr, Decatur, GA	No	Yes	Blockage removed from WCTS and lateral to restore flow	3/9/2026	13:45	Blockage removed from WCTS and lateral to restore flow
129	3/9/2026	14:40	1262 Citadel Drive, Atlanta	Yes	Yes	Flow restored to lateral and overflow area cleaned	3/9/2026	15:00	Flow restored to lateral and overflow area cleaned
130	3/10/2026	10:45	153 Avery Street, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/10/2026	12:15	Blockage removed from private lateral to restore flow
131	3/11/2026	15:00	3119 Anthony Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/11/2026	17:30	Blockage removed from private lateral to restore flow
132	3/11/2026	18:50	3517 Misty Valley Road, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/11/2026	19:30	Blockage removed from private lateral to restore flow
133	3/12/2026	9:10	113 Madison Avenue, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/12/2026	10:30	Blockage removed from private lateral to restore flow
134	3/12/2026	16:30	2479 Fontaine Circle, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	3/12/2026	17:00	Flow restored to lateral and overflow area cleaned
135	3/12/2026	19:45	3 Wiltshire Drive, Avondale Estates	Yes	Yes	Flow restored to lateral and overflow area cleaned	3/12/2026	20:15	Flow restored to lateral and overflow area cleaned
136	3/14/2026	18:45	1873 Long Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/14/2026	19:15	Blockage removed from private lateral to restore flow
137	3/15/2026	23:30	1158 Houston Mill Road, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	3/16/2026	12:00	Blockage removed from private lateral to restore flow
138	3/16/2026	9:00	5640 Rock Springs Road, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	3/16/2026	9:30	Blockage removed from private lateral to restore flow
139	3/16/2026	12:50	1214 Briar Hills Drive, Atlanta, GA, 30306	Yes	Yes	Flow restored to lateral and overflow area cleaned	3/16/2026	13:15	Flow restored to lateral and overflow area cleaned
140	3/18/2026	12:30	1989 Bandera Drive, Decatur	Yes	Yes	Flow restored to lateral and overflow area cleaned	3/18/2026	13:35	Flow restored to lateral and overflow area cleaned
141	3/18/2026	13:10	100 Fairview Street, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/18/2026	13:30	Blockage removed from private lateral to restore flow
142	3/19/2026	9:30	2398 Cove Lake Way, Lithonia	No	Yes	Blockage removed from WCTS and lateral to restore flow	3/19/2026	9:45	Blockage removed from WCTS and lateral to restore flow
143	3/19/2026	15:45	2528 Sharpsburg Court, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/19/2026	16:15	Blockage removed from private lateral to restore flow
144	3/20/2026	14:15	352 Northern Avenue, Scottdale	No	Yes	Blockage removed from WCTS and lateral to restore flow	3/20/2026	14:30	Blockage removed from WCTS and lateral to restore flow
145	3/20/2026	19:00	1158 Houston Mill Road, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	3/20/2026	20:00	Blockage removed from private lateral to restore flow
146	3/21/2026	12:15	3900 Lake Ridge Lane, Dunwoody	No	Yes	Blockage removed from WCTS and lateral to restore flow	3/21/2026	12:30	Blockage removed from WCTS and lateral to restore flow
147	3/21/2026	12:10	328 West College Avenue, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/21/2026	13:10	Blockage removed from private lateral to restore flow
148	3/23/2026	17:35	5407 East Mountain Street, Stone Mountain	Yes	Yes	Blockage removed from private lateral to restore flow	3/23/2026	18:20	Blockage removed from private lateral to restore flow
149	3/24/2026	10:45	3020 Buford Highway, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	3/24/2026	11:30	Blockage removed from private lateral to restore flow

	Date/Time		Location	Cause/Source			Flow Restoration		
Lateral Issue No.	Date Reported to DWM	Time Reported to DWM	Address	Is the WCTS Main Flowing without Blockage?	Is there a Blockage in the Lower Lateral?	Source/Additional Description	Restoration Date	Restoration Time	Flow Restoration Actions
150	3/24/2026	12:00	1158 Houston Mill Road, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	3/24/2026	12:30	Blockage removed from private lateral to restore flow
151	3/24/2026	13:20	2135 Briarcliff Road, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	3/24/2026	15:30	Blockage removed from private lateral to restore flow
152	3/25/2026	10:30	144 South Columbia Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/25/2026	11:30	Blockage removed from private lateral to restore flow
153	3/25/2026	12:30	779 Rockborough Drive, Stone Mountain	Yes	Yes	Blockage removed from private lateral to restore flow	3/25/2026	13:30	Blockage removed from private lateral to restore flow
154	3/25/2026	22:03	3488 Beachhill Drive, Doraville	Yes	Yes	Flow restored to lateral and overflow area cleaned	3/25/2026	22:45	Flow restored to lateral and overflow area cleaned
155	3/26/2026	11:00	3167 Kingfisher Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/26/2026	11:30	Blockage removed from private lateral to restore flow
156	3/26/2026	15:00	1612 Avon Avenue, Tucker	No	Yes	Blockage removed from WCTS and lateral to restore flow	3/26/2026	15:15	Blockage removed from WCTS and lateral to restore flow
157	3/26/2026	18:30	5388 Whitney Court, Stone Mountain	No	Yes	Blockage removed from WCTS and lateral to restore flow	3/26/2026	19:30	Blockage removed from WCTS and lateral to restore flow
158	3/26/2026	19:15	3535 Misty Valley Road, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/26/2026	19:45	Blockage removed from private lateral to restore flow
159	3/27/2026	15:00	3180 Lindmoor Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/27/2026	15:30	Blockage removed from private lateral to restore flow
160	3/27/2026	18:00	3981 Allenwood Way, Tucker	Yes	Yes	Blockage removed from private lateral to restore flow	3/27/2026	18:30	Blockage removed from private lateral to restore flow
161	3/28/2026	14:20	2492 Harrington Drive, Decatur	Yes	Yes	Blockage removed from private lateral to restore flow	3/28/2026	14:50	Blockage removed from private lateral to restore flow
162	3/29/2026	19:20	1407 Council Bluff Drive, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	3/29/2026	20:20	Blockage removed from private lateral to restore flow
163	3/30/2026	8:50	691 Shore Overlook, Lithonia	Yes	Yes	Blockage removed from private lateral to restore flow	3/30/2026	10:00	Blockage removed from private lateral to restore flow
164	3/30/2026	11:00	3751 Buford Highway, Atlanta	Yes	Yes	Blockage removed from private lateral to restore flow	3/30/2026	13:00	Blockage removed from private lateral to restore flow
165	3/30/2026	16:00	1225 Columbia Dr, Decatur	No	Yes	Blockage removed from WCTS and lateral to restore flow	3/30/2026	16:15	Blockage removed from WCTS and lateral to restore flow


[1] The County was asked at our meeting of April 14, 2016 to begin tracking SSO's that appear to be caused by blockages or other issues located in that section of a private service lateral that is in the County's right-of-way. This report reflects the County's best efforts to track this information.


[2] For lateral-related issues, the County provides maintenance and restorative actions to remove blockage and restore flow when a cleanout is accessible along the Right of Way. The county then notifies the property owner of the issue within the lateral and options available to prevent future blockages which may include wipes, grease, etc.

Attachment A
Additional Documentary Support

Spill 33

Date	Address	City	Time Reported	Time Stopped	Est. Vol. (gal)	Rec. Water
3/8/2026	1815 South Ponce De Leon Avenue	Atlanta	5:58 p.m.	10:40 p.m.	2,820	South Fork Peachtree Creek
Cause Due to Capacity				Rain Gauge	Rain (in)	Priority Area
Non-Capacity - GR – Grease Blockage				RGSHO2	0.90	Not a PASARP Area
Comments						
Found manhole #15-238-s202 spilling into the storm drain, into the creek due to a grease blockage in the public 8(in) sewer main. (WO- 26005053)						

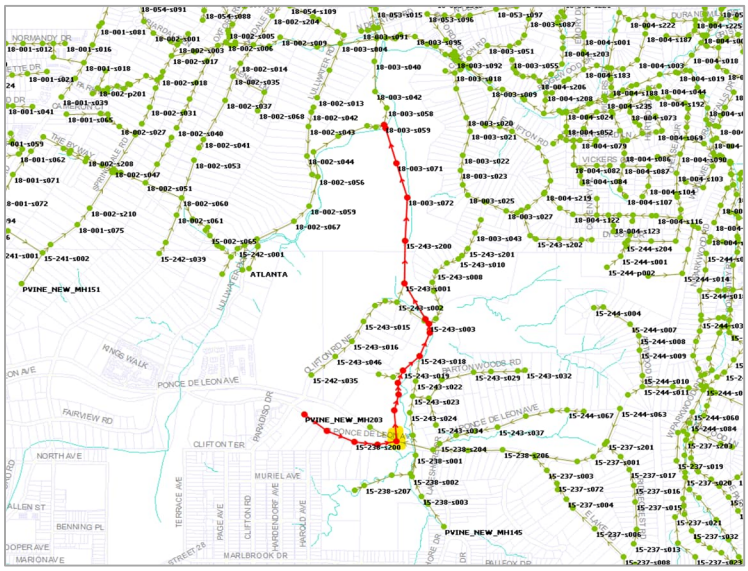

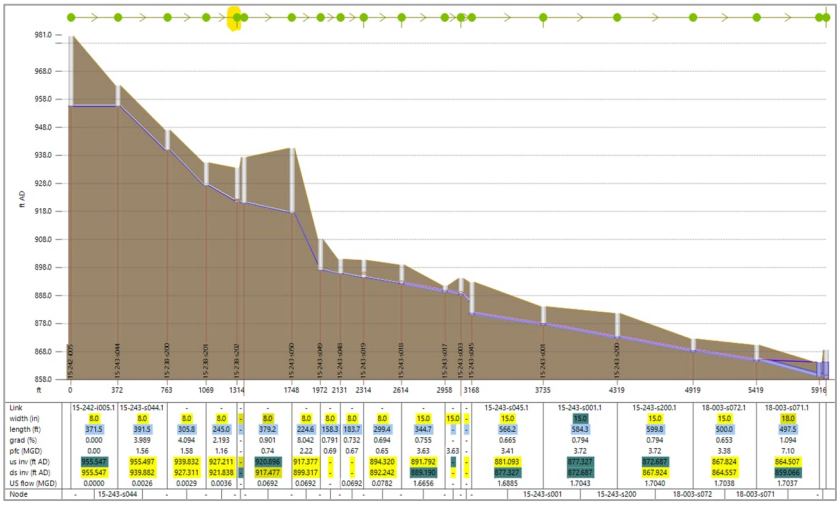

Attachment B
Priority Fix List

Attachment A – Priority Fix List

PFL Site #	Address	Capacity Related (Yes/No)	Priority Area	Sub-Model Area	MCD Deadline[1]	Date Added to PFL[2]	Date of Adequate Fix[3]
1	1078 Beech Haven Road	Yes	N/A	North Fork Peachtree Creek	09/22/25	N/A	09/16/24
2	125 Beaumont Avenue	No	N/A	South Fork Peachtree Creek	09/22/23	N/A	pre-DOE
3	1313 Stone Mill Way	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
4	1433 Deerwood Drive	Yes	I-SF3	Snapfinger	09/22/25	N/A	pre-DOE
5	1440 Sowell Estate	Yes	N/A	South Fork Peachtree Creek	09/22/25	N/A	08/29/25
6	1462 Lively Ridge Road	No	I-IG16	South Fork Peachtree Creek	09/22/23	N/A	pre-DOE
7	1496 Country Squire Drive	Yes	I-IG13	South Fork Peachtree Creek	09/22/25	N/A	04/09/22
8	157 Hood Circle	Yes	A-SF6	Intrenchment Creek	09/22/23	N/A	pre-DOE
9	1600 Autumn Hurst Court	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
10	161 Hood Circle	Yes	A-SF6	Intrenchment Creek	09/22/23	N/A	pre-DOE
11	1615 Melanie Court	Yes	I-SF3	Snapfinger	09/22/25[5]	N/A	
12	1707 Childerlee Lane	Yes	N/A	North Fork Peachtree Creek	09/22/25	N/A	
13	1787 Whitehall Forest Court	No	A-SF9	Snapfinger	09/22/23	N/A	pre-DOE
14	1942 East Starmount Way	Yes	N/A	Intrenchment Creek	09/22/25	N/A	02/08/24
15	1964 East Starmount Way	Yes	N/A	Intrenchment Creek	09/22/25	N/A	02/08/24
16	1970 East Starmount Way	Yes	N/A	Intrenchment Creek	09/22/25	N/A	02/08/24
17	2052 Grand Prix Drive	Yes	I-IG14	North Fork Peachtree Creek	09/22/25	N/A	10/19/23
18	2060 Keheley Drive	Yes	N/A	Intrenchment Creek	09/22/25	N/A	09/19/25
19	2089 Garden Circle	Yes	N/A	Intrenchment Creek	09/22/25	N/A	02/06/24
20	2301 Mountain Industrial Blvd	No	N/A	South Fork Peachtree Creek	09/22/23	N/A	pre-DOE
21	2480 Miriam Lane	Yes	I-SF3	Snapfinger	09/22/25[5]	N/A	
22	2562 Tilly Mill Road	Yes	I-IG2	Nancy Creek	09/22/25	N/A	1/31/25
23	2804 Millwood Way	Yes	I-IG13	South Fork Peachtree Creek	09/22/25	N/A	04/09/22
24	2967 Henderson Mill Road	No	N/A	North Fork Peachtree Creek	09/22/23	N/A	pre-DOE
25	307 2nd Avenue	Yes	A-SF6	Intrenchment Creek	09/22/25	N/A	10/18/25
26	3075 Thrasher Circle	Yes	I-SF3	Snapfinger	09/22/25[5]	N/A	
27	3230 Boring Road	Yes	I-SF2	Snapfinger	09/22/25[5]	N/A	
28	3330 Northlake Parkway	No	I-IG12	North Fork Peachtree Creek	09/22/25	N/A	08/11/22
29	3433 Brookfield Lane	Yes	I-SF2	Snapfinger	09/22/25	N/A	05/14/25
30	3449 Brookfield Lane	Yes	I-SF2	Snapfinger	09/22/25	N/A	05/14/25
31	3488 Keswick Drive	No	A-IG3	Nancy Creek	09/22/23	N/A	pre-DOE
32	3496 Panthersville Road	Yes	N/A	Snapfinger	09/22/25	N/A	09/15/23
33	3540 Buford Highway	No	A-IG5	North Fork Peachtree Creek	09/22/23	N/A	pre-DOE

PFL Site #	Address	Capacity Related (Yes/No)	Priority Area	Sub-Model Area	MCD Deadline[1]	Date Added to PFL[2]	Date of Adequate Fix[3]
34	3831 East Avenue	No	A-SF1	Snapfinger	09/22/23	N/A	pre-DOE
35	3892 Buford Highway	No	A-IG5	North Fork Peachtree Creek	09/22/23	N/A	pre-DOE
36	3924 Roman Court	Yes	N/A	South Fork Peachtree Creek	09/22/25	N/A	11/21/25
37	3954 Memorial College Avenue	No	N/A	Snapfinger	09/22/25	N/A	09/11/23
38	4004 Gladesworth Lane	No	I-SF2	Snapfinger	09/22/23	N/A	pre-DOE
39	4075 Memorial Drive	No	I-SF2	Snapfinger	09/22/23	N/A	pre-DOE
40	4124 Flakes Mill Road	Yes	N/A	Snapfinger	09/22/25[5]	N/A	
41	4347 Flat Shoals Parkway	Yes	I-SF2	Snapfinger	09/22/25	N/A	pre-DOE
42	4437 Wesleyan Pointe	Yes	N/A	Snapfinger	09/22/25[5]	N/A	
43	4557 Meadow Creek Path	Yes	N/A	Snapfinger	09/22/25[5]	N/A	
44	4664 Flat Bridge Road	No	N/A	Pole Bridge	09/22/23	N/A	pre-DOE
45	4776 Snapfinger Woods Drive	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
46	4900 Central Drive	No	N/A	Snapfinger	09/22/25	N/A	pre-DOE
47	4905 Wind Cove Court	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
48	5459 Bunky Way	No	N/A	Miscellaneous	09/22/25	N/A	06/22/23
49	5726 Southland Drive	No	A-PB1	Pole Bridge	09/22/23	N/A	pre-DOE
50	583 Rays Road	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
51	607 3rd Avenue	Yes	A-SF6	Intrenchment Creek	09/22/25	N/A	10/18/25
52	608 South McDonough Street	Yes	I-SF3	Snapfinger	09/22/25	N/A	Pre-DOE
53	6545 Swift Creek Drive	No	N/A	Pole Bridge	09/22/23	N/A	pre-DOE
54	6591 Tribble Street	No	N/A	Pole Bridge	09/22/23	N/A	pre-DOE
55	101 Green Street	Yes	I-SF3	Snapfinger	09/22/25	N/A	pre-DOE
56	1580 Roadhaven Drive	No	N/A	South Fork Peachtree Creek	09/22/25	N/A	pre-DOE
57	1635 Sugar Downs Court	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
58	1831 Briarcliff Circle	No	A-IG5	North Fork Peachtree Creek	09/22/23	N/A	pre-DOE
59	217 Green Street	Yes	I-SF3	Snapfinger	09/22/25[5]	N/A	
60	2190 Meadowcliff Drive	No	A-IG5	North Fork Peachtree Creek	09/22/23	N/A	pre-DOE
61	2396 Miriam Lane	No	I-SF3	Snapfinger	09/22/23	N/A	pre-DOE
62	3546 Stanford Circle	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
63	3731 Buford Highway	No	A-IG5	North Fork Peachtree Creek	09/22/23	N/A	pre-DOE
64	4980 Hammermill Road	No	N/A	South Fork Peachtree Creek	09/22/23	N/A	pre-DOE
65	8304 Union Grove Road	No	A-PB3	Pole Bridge	09/22/23	N/A	pre-DOE
66	1397 Witham Drive	No	N/A	Miscellaneous	09/22/23	N/A	pre-DOE

PFL Site #	Address	Capacity Related (Yes/No)	Priority Area	Sub-Model Area	MCD Deadline[1]	Date Added to PFL[2]	Date of Adequate Fix[3]
67	1430 Country Squire Drive	Yes	I-IG13	South Fork Peachtree Creek	09/22/25	N/A	04/09/22
68	2005 Bencal Drive	Yes	N/A	Intrenchment Creek	09/22/25	N/A	09/26/23
69	2311 Dunwoody Crossing	No	N/A	Nancy Creek	09/22/23	N/A	pre-DOE
70	294 Pine Tree Circle	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
71	3360 Mountain Drive	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
72	3480 Mill Creek Road	No	A-IG4	Nancy Creek	09/22/23	N/A	pre-DOE
73	3528 Misty Valley Road	Yes	I-SF2	Snapfinger	09/22/25	N/A	01/15/25
74	3643 Glenwood Road	No	I-SF3	Snapfinger	09/22/25	N/A	pre-DOE
75	3724 Eagles Beek Circle	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
76	4203 Clevemont Road	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
77	4495 Village Spring Run	No	N/A	Nancy Creek	09/22/23	N/A	pre-DOE
78	4711 Bishop Ming Blvd	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
79	506 South Mcdonough Street	Yes	I-SF3	Snapfinger	09/22/25	N/A	pre-DOE
80	5083 Biffle Road	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
81	6701 Peachtree Industrial Blvd	No	N/A	Nancy Creek	09/22/23	N/A	pre-DOE
82	2902 Mount Olive Drive	No	I-IG17	South Fork Peachtree Creek	09/22/23	N/A	pre-DOE
83	1410-1416, 1422 Cobb Branch Drive	Yes	I-SF2	Snapfinger	09/22/25	N/A	01/15/25
84	1420 South Hairston Road	No	N/A	Snapfinger	09/22/25	N/A	11/16/21
85	1690 Chantilly Drive	No	N/A	North Fork Peachtree Creek	09/22/23	N/A	pre-DOE
86	2000, 2200 Lithonia Industrial Boulevard	No	N/A	Pole Bridge	09/22/25	N/A	pre-DOE
87	2175 Lawrenceville Highway	No	I-IG17	South Fork Peachtree Creek	09/22/25	N/A	pre-DOE
88	2277 Munday Drive	No	I-IG6	North Fork Peachtree Creek	09/22/23	N/A	pre-DOE
89	2614 Lake Erin Drive	Yes	N/A	North Fork Peachtree Creek	09/22/25	N/A	02/20/22
90	2711 Fairlee Drive	Yes	I-SF3	Snapfinger	09/22/25[5]	N/A	
91	3037 Toney Drive	Yes	I-SF3	Snapfinger	09/22/25[5]	N/A	
92	3046 East Ponce De Leon Avenue	No	I-IG19	South Fork Peachtree Creek	09/22/23	N/A	pre-DOE
93	352 Northern Avenue	No	I-SF1	Snapfinger	09/22/23	N/A	pre-DOE
94	3548 Brookfield Lane	Yes	I-SF2	Snapfinger	09/22/25	N/A	01/15/25
95	3549 Panthersville Road	Yes	N/A	Snapfinger	09/22/25[5]	N/A	
96	3765 Foxford Drive	No	N/A	North Fork Peachtree Creek	09/22/23	N/A	pre-DOE
97	3907 Jerusalem Court	Yes	N/A	South Fork Peachtree Creek	09/22/25	N/A	12/14/21
98	3911 Roman Court	Yes	N/A	South Fork Peachtree Creek	09/22/25	N/A	11/21/25

PFL Site #	Address	Capacity Related (Yes/No)	Priority Area	Sub-Model Area	MCD Deadline[1]	Date Added to PFL[2]	Date of Adequate Fix[3]
99	4561 Amberly Court South	No	N/A	Nancy Creek	09/22/23	N/A	pre-DOE
100	4584 Lawrenceville Highway	No	N/A	Miscellaneous	09/22/23	N/A	pre-DOE
101	4948 Ardsley Drive	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
102	5495 East Mountain Street	No	N/A	Snapfinger	09/22/23	N/A	pre-DOE
103	5557 Martina Way	No	N/A	Miscellaneous	09/22/23	N/A	06/22/23
104	5224 North Peachtree Road	No	N/A	Miscellaneous	09/22/25	DOE	pre-DOE
105	3305 Lavista Road	No	I-IG13	South Fork Peachtree Creek	09/22/25	DOE	pre-DOE
106	4547 Birch Ridge Trail	No	N/A	Snapfinger	09/22/25	DOE	pre-DOE
107	4300 Carrollwood Drive	No	A-SF5	Snapfinger	09/22/25	DOE	pre-DOE
108	1995 Lithonia Industrial Blvd	No	N/A	Pole Bridge	09/22/25	DOE	pre-DOE
109	1427 Mockwell Court	No	N/A	Miscellaneous	09/22/25	DOE	pre-DOE
110	1945 Ponce De Leon Avenue	No	N/A	South Fork Peachtree Creek	09/22/25	DOE	pre-DOE
111	221 North Candler Street	No	N/A	Snapfinger	09/22/25	DOE	pre-DOE
112	116 Clairemont Avenue	No	N/A	Snapfinger	09/22/25	DOE	pre-DOE
113	2685 Milscott Drive	No	I-IG17	South Fork Peachtree Creek	09/22/25	DOE	pre-DOE
114	3854 West Nancy Creek Place	No	N/A	Nancy Creek	09/22/25	DOE	pre-DOE
115	1125 Mayfield Drive	No	N/A	South Fork Peachtree Creek	09/22/25	DOE	pre-DOE
116	2427 Briarcliff Road	No	N/A	North Fork Peachtree Creek	09/22/25	DOE	pre-DOE
117	3765 Brown Drive	No	N/A	Snapfinger	09/22/25	DOE	pre-DOE
118	5005 Leeshire Trail	No	N/A	Miscellaneous	09/22/25	DOE	pre-DOE
119	5211 Peachtree Industrial Blvd	No	A-IG3	Nancy Creek	09/22/25	DOE	pre-DOE
120	700 George Luther Drive	No	A-SF3	Snapfinger	09/22/25	DOE	pre-DOE
121	2801 Candler Road	No	N/A	Snapfinger	09/22/25	DOE	pre-DOE
122	446 Clairemont Ave	No	N/A	Snapfinger	09/22/25	DOE	pre-DOE
123	2012 Glenwood Avenue	No	N/A	Intrenchment Creek	09/22/25	DOE	pre-DOE
124	4037 Glenwood Road	No	I-SF3	Snapfinger	09/22/25	DOE	pre-DOE
125	3799 Buford Highway	No	A-IG5	North Fork Peachtree Creek	09/22/25	DOE	pre-DOE
126	3700 Buford Highway	No	A-IG5	North Fork Peachtree Creek	09/22/25	DOE	pre-DOE
127	808 Stonebridge Crescent	No	N/A	Pole Bridge	09/22/25	DOE	pre-DOE
128	1442 Canoochee Drive	No	A-IG5	North Fork Peachtree Creek	09/22/25	DOE	pre-DOE
129	949 Church Street	No	N/A	South Fork Peachtree Creek	09/22/25	DOE	08/23/22
130	2649 Tanglewood Road	No	A-IG6	South Fork Peachtree Creek	09/22/25	DOE	pre-DOE
131	149 Norris Street	No	N/A	South Fork Peachtree Creek	09/22/25	DOE	pre-DOE

PFL Site #	Address	Capacity Related (Yes/No)	Priority Area	Sub-Model Area	MCD Deadline[1]	Date Added to PFL[2]	Date of Adequate Fix[3]
132	2881 West Fairington Parkway	No	N/A	Pole Bridge	09/22/25	DOE	pre-DOE
133	6202 Peachtree Industrial Blvd	No	I-IG2	Nancy Creek	09/22/25	DOE	01/21/22
134	4053 Bosenberry Way	No	N/A	Snapfinger	09/22/25	DOE	pre-DOE
135	5393 Greenhedge Court	No	N/A	Snapfinger	09/22/25	DOE	01/23/23
136	3391 Warbler Drive	Yes	I-SF2	Snapfinger	09/22/25[5]	DOE	
137	1764 Dresden Drive	No	A-IG5	North Fork Peachtree Creek	09/22/25	DOE	pre-DOE
138	4570 Memorial Drive	No	N/A	Snapfinger	09/22/25	DOE	pre-DOE
139	1129 Biltmore Drive	No	I-IG16	South Fork Peachtree Creek	09/22/25	DOE	pre-DOE
140	4070 Greenstone Court	No	I-SF2	Snapfinger	09/22/25	DOE	pre-DOE
141	886 Granite Springs Lane	No	N/A	Snapfinger	09/22/25	DOE	pre-DOE
142	1846 Meadow Lane	No	I-SF3	Snapfinger	09/22/25	DOE	pre-DOE
143	212 Adair Street	No	N/A	Snapfinger	09/22/25	DOE	10/04/24
144	2443 East Club Drive	No	N/A	North Fork Peachtree Creek	09/22/25	DOE	04/23/24
145	3569 Springside Drive	No	I-SF2	Snapfinger	09/22/25	09/27/21	10/21/21
146	2716 Clairmont Road	No	A-IG5	North Fork Peachtree Creek	09/22/25	DOE	pre-DOE
147	2849 Oakcliff Road	No	N/A	Nancy Creek	09/22/25	11/11/21	12/27/21
148	2495 Marsh Rabbit Bend	No	N/A	Snapfinger	09/22/25	12/09/21	12/17/21
149	4415 Memorial Drive	No	A-SF3	Snapfinger	09/22/25	12/24/21	12/27/21
150	804 Town Boulevard	No	N/A	Nancy Creek	09/22/25	DOE	pre-DOE
151	4386 Cedar Ridge Trail	No	N/A	Snapfinger	09/22/25	01/11/22	05/25/22
152	1076 Village Main Street	No	N/A	Snapfinger	09/22/25	01/27/22	10/11/22
153	2914 Concord Drive	No	I-IG17	South Fork Peachtree Creek	09/22/25	02/08/22	05/20/22
154	2225 Heritage Drive	No	I-IG14	North Fork Peachtree Creek	09/22/25	02/22/22	04/24/22
155	4503 Dogwood Farms Drive	No	N/A	Snapfinger	09/22/25	02/22/22	03/03/22
156	1357 Hearst Drive	No	A-IG4	Nancy Creek	09/22/25	03/27/22	05/01/23
157	1205 Lake Hearn Drive	No	N/A	Nancy Creek	09/22/25	03/30/22	04/08/22
158	981 Byrnwyck Road	No	N/A	Nancy Creek	09/22/25	03/30/22	06/07/22
159	1955 Montreal Road West	No	I-IG13	South Fork Peachtree Creek	09/22/25	03/31/22	04/06/22
160	255 South Columbia Drive	Yes	I-SF3	Snapfinger	09/22/25[5]	04/06/22	
161	3402 Northbrook Drive	No	I-IG7	North Fork Peachtree Creek	09/22/25	04/13/22	02/17/23
162	3239 Rehoboth Drive	No	N/A	South Fork Peachtree Creek	09/22/25	04/15/22	04/16/22
163	3752 Salem Springs Court	No	N/A	Pole Bridge	09/22/25	06/09/22	12/08/23
164	4104 Tahoe Court	No	N/A	Snapfinger	09/22/25	08/04/22	10/20/23

PFL Site #	Address	Capacity Related (Yes/No)	Priority Area	Sub-Model Area	MCD Deadline[1]	Date Added to PFL[2]	Date of Adequate Fix[3]
165	2490 Brookcliff Way	No	I-IG14	North Fork Peachtree Creek	09/22/25	08/07/22	12/03/22
166	4025 Kings Causeway	No	N/A	Snapfinger	09/22/25	09/05/22	02/27/23
167	511 Oakview Road	No	I-SF3	Snapfinger	09/22/25	09/09/22	09/11/23
168	1136 Parkwood Trace	No	N/A	Snapfinger	09/22/25	09/15/22	09/21/22
169	2097 Vineyard Walk	No	N/A	Intrenchment Creek	09/22/25	10/07/22	02/20/23
170	3841 Kensington Road	No	N/A	Snapfinger	09/22/25	10/07/22	08/21/23
171	3088 Rockaway Road	No	N/A	North Fork Peachtree Creek	09/22/25	10/20/22	02/06/23
172	4061 Wintersweet Drive	No	N/A	Snapfinger	09/22/25	10/20/22	08/10/23
173	7320 Rockland Road	No	N/A	Pole Bridge	09/22/25	11/23/22	07/29/24
174	111 Church Street	No	N/A	Snapfinger	09/22/25	12/06/22	01/25/23
175	115 Perimeter Center Place	No	N/A	Nancy Creek	09/22/25	12/07/22	04/29/25
176	3664 Rockbridge Road	No	N/A	Snapfinger	09/22/25	12/24/22	02/23/23
177	2200 Fairoaks Road	No	A-IG5	North Fork Peachtree Creek	09/22/25	01/06/23	03/23/23
178	2157 Tucker Industrial Road	No	N/A	South Fork Peachtree Creek	09/22/25	01/13/23	01/27/23
179	2740 Tryon Place	No	A-IG5	North Fork Peachtree Creek	09/22/25	01/19/23	08/22/23
180	1034 McConnell Drive	No	I-IG6	South Fork Peachtree Creek	09/22/25	02/21/23	06/26/25
181	1116 Fuller Road	No	N/A	Nancy Creek	09/22/25	03/16/23	07/17/24
182	481 Pennybrook Drive	No	A-PB1	Pole Bridge	09/22/25	03/17/23	03/17/23
183	3388 Garden Mill Lane	No	N/A	Snapfinger	09/22/25	03/21/23	02/16/24
184	478 Sherwood Circle	No	A-PB1	Pole Bridge	09/22/25	03/22/23	11/18/23
185	2930 Belvedere Lane	No	I-SF3	Snapfinger	09/22/25	10/03/22	06/22/23
186	7566 Knoll Hollow Road	No	N/A	Pole Bridge	09/22/25	04/14/23	12/01/23
187	1680 Clairmont Place	No	A-IG5	North Fork Peachtree Creek	09/22/25	04/20/23	11/26/23
188	4250 Perimeter Park South	No	I-IG4	Nancy Creek	09/22/25	05/04/23	05/05/23
189	2890 Cedar Creek Drive	No	N/A	South Fork Peachtree Creek	09/22/25	06/13/23	06/15/23
190	421 Glendale Road	No	I-SF1	Snapfinger	09/22/25	06/25/23	01/19/24
191	3070 Briarcliff Road	No	A-IG5	North Fork Peachtree Creek	09/22/25	06/05/23	08/21/24
192	2477 Kings Point Drive	No	N/A	Nancy Creek	09/22/25	07/03/23	07/19/23
193	3248 Chamblee Dunwoody Road	No	I-IG6	North Fork Peachtree Creek	09/22/25	07/23/23	12/22/23
194	3174 Lynnray Drive	No	N/A	North Fork Peachtree Creek	09/22/25	07/28/23	08/10/23
195	2182 Thorncliff Drive	No	A-IG5	North Fork Peachtree Creek	09/22/25	08/01/23	03/09/24
196	1531 Woodfern Drive	No	I-SF3	Snapfinger	09/22/25	08/02/23	06/19/25
197	3273 Pinehill Drive	No	I-SF2	Snapfinger	09/22/25	08/08/23	05/14/25

PFL Site #	Address	Capacity Related (Yes/No)	Priority Area	Sub-Model Area	MCD Deadline[1]	Date Added to PFL[2]	Date of Adequate Fix[3]
198	1354 Weston Drive	Yes	I-SF2	Snapfinger	09/22/25	08/28/23	01/15/25
199	148 Desmond Drive	No	N/A	South Fork Peachtree Creek	09/22/25	08/28/23	04/24/25
200	3423 Tulip Drive	Yes	I-SF2	Snapfinger	09/22/25	08/28/23	01/15/25
201	3088 Rockaway Road	No	N/A	North Fork Peachtree Creek	10/03/25	10/03/23	05/31/24
202	4601 Buford Highway	No	I-IG6	North Fork Peachtree Creek	10/06/25	10/06/23	01/02/24
203	1127 Village Street	No	N/A	Snapfinger	10/06/25	10/06/23	11/29/23
204	3569 Larkspur Terrace	No	I-SF2	Snapfinger	10/11/25	10/11/23	11/26/24
205	300 Hatton Drive	No	I-SF1	Snapfinger	10/11/25	10/11/23	03/28/24
206	1953 Crescent Centre Boulevard	No	I-IG13	South Fork Peachtree Creek	11/30/25	11/30/23	12/06/23
207	3009 Fair Creek Court	No	A-PB6	Pole Bridge	12/15/25	12/15/23	04/22/24
208	5062 Stone Trace	No	A-SF2	Snapfinger	01/09/26	01/09/24	11/18/24
209	4265 Glenwood Road	No	I-SF2	Snapfinger	01/09/26	01/09/24	11/26/24
210	1530 Burnstone Drive	No	N/A	Pole Bridge	02/12/26	02/12/24	02/12/24
211	1080 Bailiff Court	No	N/A	Nancy Creek	03/01/26	03/01/24	05/14/24
212	725 San Miguel Drive	No	A-SF2	Snapfinger	03/04/26	03/04/24	03/28/24
213	1517 Eidson Hall Drive	No	N/A	Nancy Creek	03/05/26	03/05/24	03/11/24
214	2317 Briarcliff Road	No	N/A	North Fork Peachtree Creek	03/08/26	03/08/24	05/22/25
215	1817 Clifton Road	No	N/A	South Fork Peachtree Creek	03/11/26	03/11/24	05/06/24
216	2413 Carlow Court	No	I-SF2	Snapfinger	03/19/26	03/19/24	03/28/24
217	2121 Tucker Industrial Road	No	N/A	South Fork Peachtree Creek	03/23/26	03/23/24	05/31/24
218	3045 Wadsworth Mill Place	No	I-SF3	Snapfinger	03/28/26	03/28/24	02/21/25
219	3172 Bobbie Lane	No	I-SF2	Snapfinger	04/14/26	04/14/24	01/16/25
220	1449 Canoochee Drive	No	A-IG5	North Fork Peachtree Creek	04/20/26	04/20/24	10/15/24
221	6682 Peachtree Industrial Blvd	No	N/A	Nancy Creek	05/01/26	05/01/24	06/05/25
222	2417 Dawn Drive	No	A-SF8	Snapfinger	05/08/26	05/08/24	02/04/25
223	4109 Hideaway Drive	No	N/A	South Fork Peachtree Creek	05/09/26	05/09/24	08/29/25
224	3066 Buford Highway	No	N/A	North Fork Peachtree Creek	05/22/26	05/22/24	05/24/24
225	5250 Snapfinger Park Drive	No	N/A	Snapfinger	05/23/26	05/23/24	11/11/25[4]
226	3752 Cherry Ridge Blvd	No	N/A	Snapfinger	06/01/26	06/01/24	07/13/24
227	4165 Hideaway Drive	No	N/A	South Fork Peachtree Creek	06/04/26	06/04/24	08/29/25
228	2547 Lithonia West Drive	No	N/A	Pole Bridge	06/16/26	06/16/24	08/06/24
229	6009 Memorial Drive	No	N/A	Snapfinger	06/19/26	06/19/24	07/09/24
230	4027 Flakes Mill Road	No	N/A	Snapfinger	04/04/26	04/04/24	09/26/25

PFL Site #	Address	Capacity Related (Yes/No)	Priority Area	Sub-Model Area	MCD Deadline[1]	Date Added to PFL[2]	Date of Adequate Fix[3]
231	3902 Memorial College Avenue	Yes	N/A	Snapfinger	07/08/26	07/08/24	11/14/25
232	3850 Memorial Drive	No	I-SF2	Snapfinger	07/23/26	07/23/24	01/16/25
233	1143 Banbury Cross	No	I-SF2	Snapfinger	08/03/26	08/03/24	01/16/25
234	1595 Moncrief Circle	No	I-IG13	South Fork Peachtree Creek	08/06/26	08/06/24	06/18/25
235	921 2nd Street	No	N/A	Snapfinger	08/08/26	08/08/24	
236	1579 Drayton Woods Drive	No	N/A	Snapfinger	08/10/26	08/10/24	09/11/24
237	3565 Lawrenceville Highway	No	N/A	South Fork Peachtree Creek	09/20/26	09/20/24	07/01/25
238	3908 Woburn Road	No	N/A	South Fork Peachtree Creek	10/23/26	10/23/24	01/21/25
239	3342 North Druid Hills Road	No	A-IG7	South Fork Peachtree Creek	11/12/26	11/12/24	09/19/25
240	5009 Memorial Drive	No	N/A	Snapfinger	11/21/26	11/21/24	12/05/24
241	2473 East Club Drive	No	N/A	North Fork Peachtree Creek	11/27/26	11/27/24	
242	5440 North Peachtree Road	No	N/A	Miscellaneous	12/03/26	12/03/24	12/09/24
243	822 North Indian Creek Drive	No	N/A	Snapfinger	12/05/26	12/05/24	12/17/24
244	2100 Winterspark Drive	No	N/A	Nancy Creek	12/08/26	12/08/24	06/12/25
245	2402 Tiffany Circle	No	I-SF2	Snapfinger	12/18/26	12/18/24	
246	4323 Winters Chapel Road	No	N/A	Nancy Creek	12/26/26	12/26/24	06/12/25
247	1431 Conway Road	Yes	I-SF3	Snapfinger	06/30/27[5]	03/14/25	
248	2829 Dresden Drive	No	I-IG6	North Fork Peachtree Creek	01/07/27	01/07/25	04/02/25
249	3052 Wells Street	No	I-IG19	South Fork Peachtree Creek	01/10/27	01/10/25	08/01/25
250	773 Shadow Lakes Drive	No	N/A	Pole Bridge	02/04/27	02/04/25	04/01/25
251	3001 Mccall Drive	No	N/A	North Fork Peachtree Creek	02/10/27	02/10/25	
252	5100 East Ponce De Leon Ave	No	N/A	South Fork Peachtree Creek	02/19/27	02/19/25	04/01/25
253	1302 Mannbrook Drive	No	A-SF5	Snapfinger	02/27/27	02/27/25	04/10/25
254	1529 Harbour Oaks Road	No	N/A	South Fork Peachtree Creek	03/22/27	03/22/25	08/29/25
255	400 Perimeter Center Terr	No	N/A	Nancy Creek	03/31/27	03/31/25	
256	3575 Oakvale Road	No	N/A	Snapfinger	03/15/27	03/15/25	07/24/25[4]
257	1421 Mockwell Court	No	N/A	Miscellaneous	04/14/27	04/14/25	05/26/25
258	1471 Northeast Expressway	No	N/A	North Fork Peachtree Creek	04/30/27	04/30/25	
259	1377 Hearst Drive	No	A-IG4	Nancy Creek	06/02/27	06/02/25	
260	1335 Church Street	No	N/A	South Fork Peachtree Creek	06/07/27	06/07/25	02/12/26
261	2595 Rockcliff Road	No	N/A	Intrenchment Creek	07/29/27	07/29/25	
262	1659 Briarcliff Road	No	N/A	South Fork Peachtree Creek	07/30/27	07/30/25	
263	1111 Rankin Street	No	N/A	Snapfinger	07/31/27	07/31/25	

PFL Site #	Address	Capacity Related (Yes/No)	Priority Area	Sub-Model Area	MCD Deadline[1]	Date Added to PFL[2]	Date of Adequate Fix[3]
264	2443 Hunting Valley Drive	No	N/A	South Fork Peachtree Creek	08/21/27	08/21/25	09/02/25
265	3370 Panthersville Road	No	N/A	Snapfinger	08/25/27	08/25/25	11/20/25[4]
266	1011 Lenox Valley	No	N/A	North Fork Peachtree Creek	08/28/27	08/28/25	10/16/25[4]
	3294 Lansbury Village Drive[6]	No	N/A	North Fork Peachtree Creek	10/03/27	10/03/25	
267	2542 Maclaren Circle	No	N/A	Miscellaneous	10/14/27	10/14/25	10/28/25[4]
268	3251 Wake Robin Trail	No	N/A	North Fork Peachtree Creek	11/11/27	11/11/25	11/18/25
269	446 Clairemont Ave	No	N/A	Snapfinger	12/27/27	12/27/25	
270	3352 Embry Hills Drive	No	I-IG8	North Fork Peachtree Creek	08/24/27	08/24/25	03/26/26
271	351 Hillcrest Avenue	No	N/A	South Fork Peachtree Creek	09/18/27	09/18/25	09/19/25[4]
272	4301 Covington Highway	No	I-SF2	Snapfinger	11/17/27	11/17/25	
273	4666 South Hope Spring	No	N/A	Snapfinger	01/06/28	01/06/26	02/24/26
274	1380 Snapfinger Road	No	I-SF2	Snapfinger	01/14/28	01/14/26	
275	2247 Northlake Parkway	No	I-IG2	North Fork Peachtree Creek	02/03/26	02/03/28	03/05/26
276	2097 Vineyard Walk	No	N/A	Intrenchment Creek	02/11/28	02/11/26	
277	2313 Briarcliff Road	No	N/A	North Fork Peachtree Creek	02/23/28	02/23/26	
278	4776 Snapfinger Woods Drive	No	N/A	Snapfinger	03/08/28	03/08/26	
279	100 Fairview Street	No	N/A	South Fork Peachtree Creek	03/17/28	03/17/26	
280	1225 Columbia Drive	No	I-SF3	Snapfinger	03/30/28	03/30/26	

[1]The MCD authorizes the County to request additional time to Adequately Fix PFL sites and the County has submitted requests for PFL site Nos. 11, 21, 26, 27, 40, 42, 43, 59, 90, 91, 95, 136, 160

[2]DOE means Date of Entry (09/22/21).

[3]pre-DOE denotes PFL sites confirmed as Adequately Fixed in connection with the 3Q2021 reporting process

[4]Adequate Fix of the PFL site occurred in a prior reporting period with final analysis and documentation completed within this reporting period.

[5]Site associated with large-diameter capacity trunk sewer projects in the Snapfinger Basin.

6Site added to the 4Q2025 Report in error as explained on page 3 of the 1Q2026 Report.

As provided by the Modified Consent Decree and consistent with the County's notices to EPA/EPD obligations, certain SSOs (e.g., those caused by a Severe Natural Condition) have not been considered when determining whether a site is a Repeat SSO Location. Modified Consent Decree, ¶ 36(j).